

MAKING MODERN LIVING POSSIBLE

*Danfoss*



## **Maneurop® reciprocating compressors**

**MT/MTZ 50 - 60 Hz - R22 - R407C - R134a - R404A / R507A**

MANEUROP® RECIPROCATING COMPRESSORS .....	p 3
COMPRESSOR MODEL DESIGNATION .....	p 4
Code numbers .....	p 4
Compressor reference .....	p 4
Versions .....	p 4
SPECIFICATIONS .....	p 5
Technical specifications .....	p 5
Approvals & certificates .....	p 5
Nominal performance for R404A and R22 .....	p 6
Nominal performance for R407C and R134a .....	p 7
OPERATING ENVELOPES .....	p 8
OUTLINE DRAWINGS .....	p 10
1 cylinder .....	p 10
2 cylinders .....	p 11
4 cylinders .....	p 12
ELECTRICAL CONNECTIONS AND WIRING .....	p 13
Single phase electrical characteristics .....	p 13
Nominal capacitor values and relays .....	p 13
Trickle circuit .....	p 13
PSC wiring .....	p 13
CSR wiring .....	p 13
Suggested wiring diagrams .....	p 14
Three phase electrical characteristics .....	p 15
Motor protection and wiring diagrams .....	p 15
Soft starters .....	p 16
Voltage application range .....	p 16
IP rating .....	p 16
REFRIGERANTS AND LUBRICANTS .....	p 17
General information .....	p 17
SYSTEM DESIGN RECOMMENDATIONS .....	p 19
Piping design .....	p 19
Operating limits .....	p 20
Operating voltage & cycle rate .....	p 21
Liquid refrigerant control & charge limits .....	p 21
SOUND AND VIBRATION MANAGEMENT .....	p 23
Sound .....	p 23
Vibration .....	p 23
INSTALLATION AND SERVICE .....	p 24
System cleanliness .....	p 24
Compressor handling, mounting and connection to the system .....	p 24
System pressure test .....	p 25
Leak detection .....	p 25
Vacuum pull down - moisture removal .....	p 25
Start-up .....	p 26
ORDERING INFORMATION AND PACKAGING .....	p 27
Packaging .....	p 27
Ordering information .....	p 28

**Application guidelines**
**Maneurop® reciprocating compressors**

Maneurop® reciprocating compressors from Danfoss Commercial Compressors are specially designed for applications with a wide range of operating conditions. All components are of high quality and precision in order to assure a long product life.

R407C, R134a, R404A, and R507A, using 160PZ polyester oil as lubricant.

Maneurop® MT and MTZ series compressors are of the hermetic reciprocating type and are designed for medium and high evaporating temperature applications.

MTZ compressors can be used in new installations and also to replace Maneurop® MTE compressors in existing installations.

The compressor design allows for the motor to be 100% suction-gas cooled.

MT and MTZ compressors have a large internal free volume that protects against the risk of liquid hammering when liquid refrigerant enters the compressor.

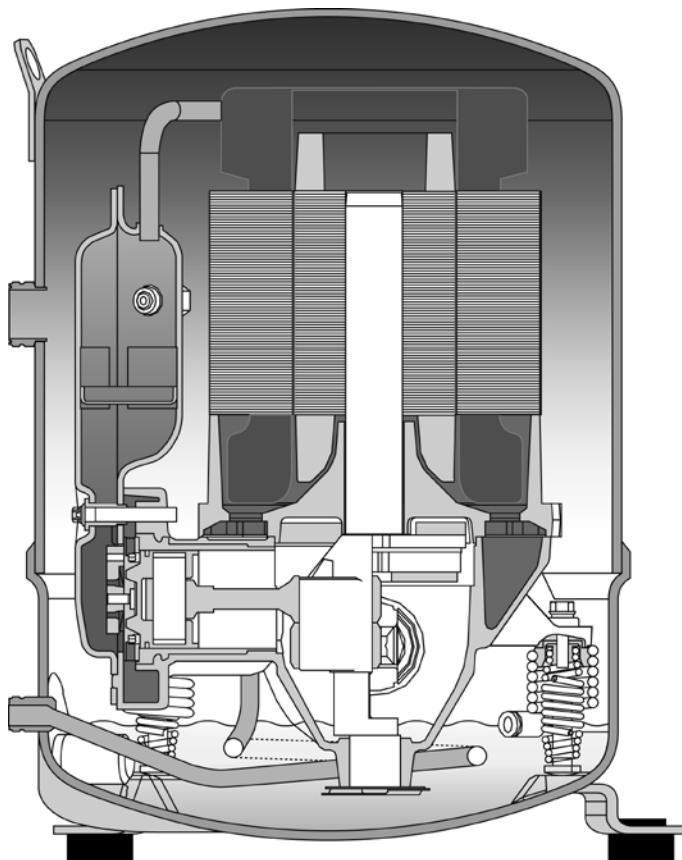
The positive benefits of internal motor protection, high efficiency circular valve design and high torque motors provide for a quality installation.

MT and MTZ compressors are fully suction-gas cooled. This means that no additional compressor cooling is required and allows the compressors to be insulated with acoustic jackets, to obtain lower sound levels, without the risk of compressor overheating.

The MT series is designed for use with the "traditional" R22 refrigerant, using Danfoss mineral oil 160P as lubricant.

MT and MTZ compressors are available in 22 different models with displacement ranging from 1.84 to 16.57 in<sup>3</sup>/rev. Seven different motor voltage ranges are available for single and three phase power supplies at 50 and 60 Hz. Most compressors exist in two versions:


- standard version
- VE version (oil equalization + oil sight glass).



## Application guidelines


## Compressor model designation
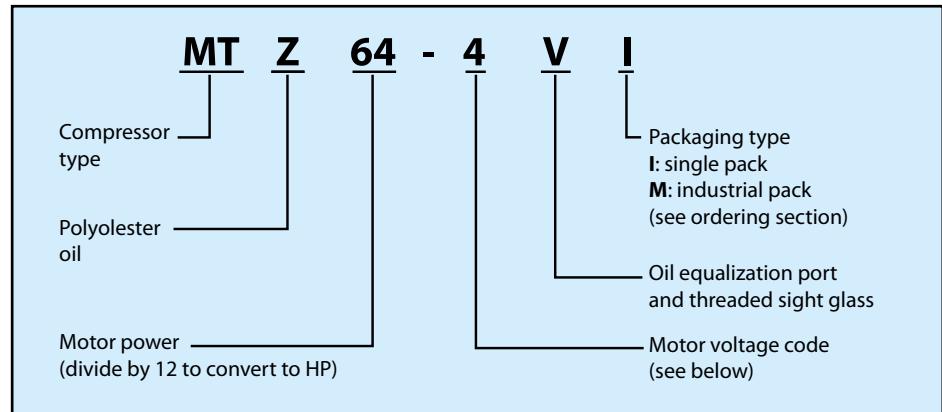
### Code numbers (for ordering)



Available code numbers are listed on pages 28-29

### Compressor reference (indicated on the compressor nameplate)

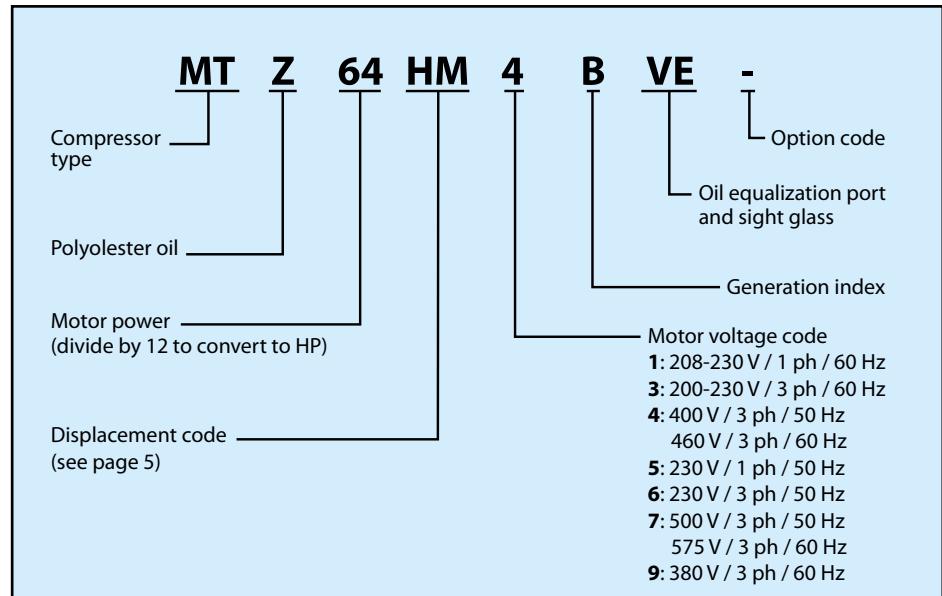

### Versions

Models	S version		VE version	
	Oil sight glass	Oil equalization connection	Oil sight glass	Oil equalization connection
MT/MTZ018-040 (1 cyl.)	-	-	threaded	3/8"flare
MT/MTZ044-081 (2 cyl.)	-	-	threaded	3/8"flare
MT/MTZ100-160 (4 cyl.)	welded	-	threaded	3/8"flare

**Application guidelines**
**Specifications**

Compressor model	Displacement			Cyl. number	Oil charge oz	Net weight lbs	Available motor voltage codes						
	Code	in³/rev	cfh at 3600 rpm				1	3	4	5	6	7	9
MT/MTZ018	JA	1.84	231	1	32	46	●	●	●	●	-	-	-
MT/MTZ022	JC	2.33	291	1	32	46	●	●	●	●	●	-	●
MT/MTZ028	JE	2.93	367	1	32	51	●	●	●	●	●	-	●
MT/MTZ032	JF	3.29	411	1	32	53	●	●	●	●	●	○	●
MT/MTZ036	JG	3.69	461	1	32	55	●	●	●	●	●	○	●
MT/MTZ040	JH	4.14	518	1	32	57	●	●	●	-	●	-	-
MT/MTZ044	HJ	4.65	581	2	61	77	●	●	●	-	●	●	●
MT/MTZ045	HJ	4.65	581	2	61	77	-	●	●	-	-	-	-
MT/MTZ050	HK	5.23	653	2	61	77	●	●	●	●	●	●	●
MT/MTZ051	HK	5.23	653	2	61	77	-	●	●	-	-	-	-
MT/MTZ056	HL	5.87	733	2	61	82	●	●	●	-	●	●	●
MT/MTZ057	HL	5.87	733	2	61	82	-	●	●	-	-	-	-
MT/MTZ064	HM	6.57	822	2	61	82	●	●	●	-	●	-	●
MT/MTZ065	HM	6.57	822	2	61	82	-	●	●	-	-	-	-
MT/MTZ072	HN	7.38	922	2	61	88	-	●	●	-	●	-	●
MT/MTZ073	HN	7.38	922	2	61	88	-	●	●	-	-	-	-
MT/MTZ080	HP	8.29	1036	2	61	88	-	●	●	-	●	-	●
MT/MTZ081	HP	8.29	1036	2	61	88	-	●	●	-	-	-	-
MT/MTZ100	HS	10.45	1306	4	132	132	-	●	●	-	●	●	●
MT/MTZ125	HU	13.15	1643	4	132	141	-	●	●	-	●	●	●
MT/MTZ144	HV	14.76	1845	4	132	148	-	●	●	-	●	●	●
MT/MTZ160	HW	16.57	2071	4	132	152	-	●	●	-	●	●	●

● Available in MT and MTZ

○ Available in MTZ only

**Approvals and certificates**

Maneurop® MT/MTZ compressors comply with the following approvals and certificates.

Certificates are listed on the product datasheets: <http://www.danfoss.com/odsg>

CE 0062 or CE 0038 (European Directive)		All models
UL (Underwriters Laboratories)		All 60 Hz models
CCC (China Compulsory Product Certification)		Depending on the model and motor voltage code.
Gost certificate (for Russia)		Depending on the model and motor voltage code.

**Pressure equipment directive 97/23/EC**

Products	MT/ MTZ 18 to 40	MT/ MTZ 44 to 160
Refrigerating fluids	Group 2	Group 2
Category PED	I	II
Evaluation module	no scope	D1
Service temperature - Ts	122°F < Ts > -31°F	122°F < Ts > -31°F
MT - Service pressure - Ps	267 psig	267 psig
MTZ - Service pressure - Ps	328 psig	328 psig

**Low voltage directive  
73/23/EC, 93/68/EC**

Products	MT/ MTZ 18 to 40	MT/ MTZ 44 to 160
Manufacturer's declaration of incorporation ref. EC Machines Directives 98/392/CE	PED005C	PED005C

**Internal free volume**

Products	Volume (gallon)
1 cyl. with height = 13.1 in. (see page 10)	1.9
1 cyl. with height = 14 in. (see page 10)	2.0
2 cyl.	4.4
4 cyl . with height = 20.4 in. (see page 12)	8.1
4 cyl. with height = 21.26 in. (see page 12)	8.5

**Application guidelines**
**Specifications**
**Nominal performance data for R404A and R22**

R-404A	Refrigeration											
Compressor model	50 Hz, EN12900 ratings To = 14°F, Tc = 113°F, SC = 0°F, SH = 18°F				50 Hz, ARI ratings To = 20°F, Tc = 120°F, SC = 0°F, SH = 20°F				60 Hz, ARI ratings To = 20°F, Tc = 120°F, SC = 0°F, SH = 20°F			
	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh
MTZ018-4*	6500	1.21	2.73	5.40	7070	1.31	2.86	5.40	8980	1.76	2.86	5.09
MTZ022-4*	8950	1.48	3.06	6.04	9665	1.62	3.24	5.96	12300	2.05	3.27	6.00
MTZ028-4*	11700	1.96	4.04	5.98	12600	2.14	4.30	5.88	15980	2.68	4.23	5.95
MTZ032-4*	13600	2.16	4.25	6.28	14550	2.37	4.56	6.15	17450	2.98	4.56	5.85
MTZ036-4*	15950	2.58	4.95	6.18	17400	2.83	5.33	6.02	20150	3.33	5.09	6.04
MTZ040-4*	18200	2.95	5.87	6.18	19400	3.24	6.29	5.97	23000	3.76	5.88	6.11
MTZ044-4	17600	3.16	6.37	5.57	18900	3.43	6.66	5.51	24250	4.18	6.58	5.79
MTZ045-4*	18350	2.77	5.35	6.59	19750	3.02	5.67	6.53	24250	3.85	5.85	6.30
MTZ050-4	27000	3.61	6.53	5.81	22470	3.92	6.92	5.73	28300	4.82	7.04	5.87
MTZ051-4*	21380	3.22	5.95	6.63	22880	3.50	6.33	6.54	28550	4.42	6.53	6.46
MTZ056-4	23900	4.00	7.07	5.98	25600	4.38	7.57	5.85	31800	5.44	7.80	5.84
MTZ057-4*	22900	3.51	6.83	6.52	24750	3.85	7.25	6.43	32400	4.98	7.52	6.50
MTZ064-4	27760	4.54	8.30	6.11	29700	4.96	8.84	5.99	36730	6.11	8.98	5.91
MTZ065-4*	27250	4.20	7.82	6.49	29340	4.60	8.35	6.37	36000	5.67	8.31	6.35
MTZ072-4	31250	4.99	8.64	6.28	33330	5.45	9.28	6.11	40470	6.91	9.76	5.85
MTZ073-4*	30460	4.69	8.95	6.49	32680	5.11	9.50	6.39	40850	6.53	9.73	6.25
MTZ080-4	35930	5.84	10.12	6.15	38250	6.38	10.87	5.99	45760	8.03	11.35	5.70
MTZ081-4*	35750	5.61	10.20	6.39	38780	6.14	10.94	6.22	46450	7.81	11.35	5.94
MTZ100-4*	41940	6.76	12.21	6.22	44500	7.35	12.94	6.11	52850	8.72	12.79	6.06
MTZ125-4*	53650	8.44	13.79	6.35	57380	9.21	14.86	6.22	68200	11.37	15.41	6.00
MTZ144-4*	63150	9.78	16.29	6.45	67240	10.65	17.47	6.31	80350	12.99	17.93	6.18
MTZ160-4*	69350	11.08	18.26	6.25	73970	12.09	19.64	6.11	87300	14.73	20.17	5.92

\* 50 Hz, EN12900 data for indicated models are Asercom certified

R404A data are also valid for refrigerant R507A

R-22	Refrigeration				Air Conditioning							
Compressor model	50 Hz, EN12900 ratings To = 14°F, Tc = 113°F, SC = 0°F, SH = 18°F				50 Hz, ARI ratings To = +45°F, Tc = 130°F, SC = 15°F, SH = 20°F				60 Hz, ARI ratings To = +45°F, Tc = 130°F, SC = 15°F, SH = 20°F			
	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh
MT018-4	5770	1.00	2.27	5.77	13250	1.45	2.73	9.16	15900	1.74	2.73	9.16
MT022-4	8500	1.29	2.55	6.63	18305	1.89	3.31	9.69	22000	2.27	3.31	9.69
MT028-4	12750	1.81	3.59	7.04	25200	2.55	4.56	9.87	30200	3.06	4.56	9.87
MT032-4	13500	2.11	3.73	6.39	27500	2.98	4.97	9.22	33000	3.58	4.97	9.22
MT036-4	16400	2.35	4.30	6.97	31650	3.37	5.77	9.38	38000	4.05	5.77	9.38
MT040-4	17800	2.67	4.86	6.66	35800	3.86	6.47	9.27	42900	4.63	6.47	9.27
MT044-4	18100	2.72	6.03	6.66	37700	3.89	7.37	9.69	45200	4.66	7.37	9.69
MT045-4	16600	2.46	5.02	6.76	35900	3.53	6.37	10.17	44000	4.32	6.42	10.18
MT050-4	19850	2.95	5.22	6.73	42100	4.32	8.46	9.74	50500	5.18	8.46	9.74
MT051-4	20050	2.94	5.53	6.83	41800	4.19	7.20	9.97	50200	5.04	7.26	9.95
MT056-4	23300	3.44	6.21	6.80	47000	5.04	10.27	9.32	56400	6.05	10.27	9.32
MT057-4	22000	3.18	6.39	6.93	47000	4.58	8.19	10.24	56400	5.58	8.23	10.10
MT064-4	26100	3.89	7.06	6.69	54000	5.66	9.54	9.53	64800	6.80	9.54	9.53
MT065-4	26470	3.64	7.03	7.27	53700	5.27	9.16	10.18	64400	6.32	9.33	10.18
MT072-4	29100	4.29	7.58	6.80	58500	6.31	10.54	9.26	70200	7.57	10.54	9.26
MT073-4	29750	4.19	8.48	7.10	62100	6.12	10.98	10.15	74600	7.33	10.77	10.16
MT080-4	33200	4.84	8.24	6.86	66700	7.13	11.58	9.36	80000	8.55	11.58	9.36
MT081-4	35380	4.89	9.52	7.24	70800	7.08	12.48	9.99	85000	8.50	12.34	10.00
MT100-4	38700	5.79	11.82	6.69	79900	7.98	14.59	10.00	95900	9.58	14.59	10.00
MT125-4	52100	7.55	12.28	6.90	103900	10.66	17.37	9.74	124700	12.80	17.37	9.74
MT144-4	59000	8.47	17.06	6.97	117300	11.95	22.75	9.80	140700	14.35	22.75	9.80
MT160-4	65540	9.49	16.81	6.90	130700	13.40	22.16	9.75	156900	16.08	22.16	9.75

To: Evaporating temperature at dew point (saturated suction temperature)

ARI capacity and power input data are +/- 5%

Tc: Condensing temperature at dew point (saturated discharge temperature)

Asercom: Association of European Refrigeration Compressor and

SC: Subcooling,

Controls Manufacturers

SH: Superheat

ARI: Air Conditioning and Refrigeration Institute

**Application guidelines**
**Specifications**
**Nominal performance data for R407C and R134a**

R-407C	Air Conditioning											
Compressor model	50 Hz, EN12900 ratings To = +45°F, Tc = 130°F, SC = 15°F, SH = 20°F				50 Hz, ARI ratings To = +45°F, Tc = 130°F, SC = 15°F, SH = 20°F				60 Hz, ARI ratings To = +45°F, Tc = 130°F, SC = 15°F, SH = 20°F			
	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh
MTZ018-4*	11850	1.27	2.73	9.32	13150	1.38	2.86	9.53	17250	1.73	2.82	9.98
MTZ022-4*	15540	1.71	3.27	9.12	17140	1.86	3.47	9.23	21450	2.26	3.45	9.48
MTZ028-4*	20080	2.17	4.30	9.29	22340	2.36	4.57	9.45	28070	2.82	4.41	9.93
MTZ032-4*	22700	2.43	4.57	9.36	25030	2.65	4.90	9.43	30702	3.20	4.80	9.61
MTZ036-4*	25650	2.93	5.58	8.74	28280	3.21	5.99	8.82	34120	3.90	5.78	8.74
MTZ040-4*	29580	3.40	6.46	8.71	32720	3.71	6.92	8.81	40030	4.46	6.69	8.98
MTZ044-4	30530	3.34	6.10	9.12	33710	3.63	6.49	9.27	43030	4.36	6.84	9.85
MTZ045-4*	31180	3.12	5.84	10.01	34490	3.38	6.18	10.21	43480	4.25	6.34	10.23
MTZ050-4	34800	3.79	6.90	9.19	38490	4.11	7.34	9.34	48150	4.95	7.33	9.72
MTZ051-4*	35590	3.69	6.51	9.66	39380	4.01	6.95	9.82	48190	4.87	7.06	9.89
MTZ056-4	39960	4.32	7.85	9.26	44190	4.69	8.36	9.42	54370	5.66	8.41	9.60
MTZ057-4*	39900	4.02	7.45	9.90	44400	4.37	7.91	10.16	54880	5.40	8.03	10.15
MTZ064-4	45010	4.84	8.79	9.29	49830	5.26	9.35	9.47	60450	6.35	9.47	9.50
MTZ065-4*	45630	4.61	8.35	9.90	50720	5.02	8.91	10.10	61750	6.14	9.01	10.05
MTZ072-4	50540	5.50	9.81	9.19	55940	5.97	10.48	9.36	67930	7.21	10.78	9.41
MTZ073-4*	52230	5.42	9.85	9.66	58230	5.87	10.48	9.91	70970	7.30	10.61	9.72
MTZ080-4	57204	6.29	11.02	9.08	63280	6.83	11.83	9.25	76910	8.24	12.35	9.33
MTZ081-4*	59360	6.29	11.31	9.43	66010	6.83	12.08	9.67	78100	8.24	11.99	9.47
MTZ100-4*	69940	7.38	13.05	9.49	77520	8.00	13.83	9.69	96380	9.86	14.22	9.77
MTZ125-4*	91880	9.48	15.14	9.70	101740	10.32	16.28	9.85	121650	12.83	18.07	9.47
MTZ144-4*	101670	10.68	17.55	9.53	112940	11.59	18.80	9.74	139680	14.42	19.81	9.68
MTZ160-4*	116420	12.40	20.08	9.39	129160	13.46	21.50	9.59	154430	16.64	22.46	9.27

\* 50 Hz, EN12900 data for indicated models are Asercom certified

R-134a	Air Conditioning											
Compressor model	50 Hz, EN12900 ratings To = 41 °F, Tc = 122 °F, SC = 0 °F, SH = 18 °F				50 Hz, ARI ratings To = +45°F, Tc = 130°F, SC = 15°F, SH = 20°F				60 Hz, ARI ratings To = +45°F, Tc = 130°F, SC = 15°F, SH = 20°F			
	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh	Cooling capacity BTU/h	Power input kW	Current input A	E.E.R. BTU/Wh
MTZ018-4	7890	0.92	2.12	8.57	8710	0.99	2.19	8.81	11200	1.22	2.09	9.20
MTZ022-4	10250	1.11	2.42	9.22	11440	1.20	2.51	9.56	14860	1.54	2.56	9.63
MTZ028-4	12740	1.41	3.18	9.05	14380	1.53	3.30	9.40	19260	2.04	3.37	9.43
MTZ032-4	14990	1.74	3.80	8.61	16910	1.87	3.94	9.03	20940	2.39	3.89	8.76
MTZ036-4	18240	1.97	3.88	9.26	20490	2.13	4.09	9.60	24490	2.75	4.20	8.91
MTZ040-4	19470	2.15	4.58	9.08	27860	2.33	4.89	9.36	27870	3.08	4.72	9.03
MTZ044-4	20900	2.36	5.51	8.88	23460	2.52	5.65	9.29	29850	3.14	5.47	9.51
MTZ045-4	20800	2.06	4.56	10.11	23390	2.22	4.73	10.53	30120	2.84	4.70	10.59
MTZ050-4	24490	2.68	5.33	9.12	27560	2.88	5.50	9.57	34460	3.60	5.36	9.57
MTZ051-4	24280	2.44	5.02	9.96	27360	2.63	5.20	10.39	34530	3.29	5.33	10.48
MTZ056-4	27460	2.99	5.61	9.19	30980	3.21	5.83	9.63	38010	3.95	5.92	9.62
MTZ057-4	26230	2.62	5.93	10.01	29780	2.84	6.17	10.47	38870	3.82	6.37	10.16
MTZ064-4	31280	3.36	6.66	9.32	35350	3.62	6.96	9.77	45290	4.68	7.11	9.67
MTZ065-4	30600	3.02	6.53	10.11	34700	3.26	6.81	10.63	44400	4.20	6.77	10.56
MTZ072-4	36000	3.74	6.83	9.63	40470	4.01	7.20	10.09	50000	5.19	7.59	9.64
MTZ073-4	34940	3.50	7.66	9.97	39790	3.78	7.99	10.52	50000	4.81	7.88	10.39
MTZ080-4	47260	4.31	8.03	9.56	46380	4.64	8.45	10.00	56520	5.99	8.79	9.42
MTZ081-4	40130	4.02	8.44	9.97	45490	4.35	8.83	10.44	56320	5.47	8.68	10.29
MTZ100-4	47030	4.89	9.84	9.60	53040	5.28	10.24	10.04	63970	6.50	10.11	9.84
MTZ125-4	57990	5.84	10.24	9.94	65130	6.29	10.80	10.35	79920	7.71	11.09	10.23
MTZ144-4	71820	7.27	13.11	9.87	80670	7.83	13.78	10.30	96960	9.81	14.28	9.87
MTZ160-4	78820	7.98	13.90	9.87	88320	8.57	14.67	10.29	107650	10.91	15.54	9.86

To: Evaporating temperature at dew point (saturated suction temperature)

Tc: Condensing temperature at dew point (saturated discharge temperature)

SC: Subcooling,

SH: Superheat

ARI capacity and power input data are +/- 5%

Asercom: Association of European Refrigeration Compressor and

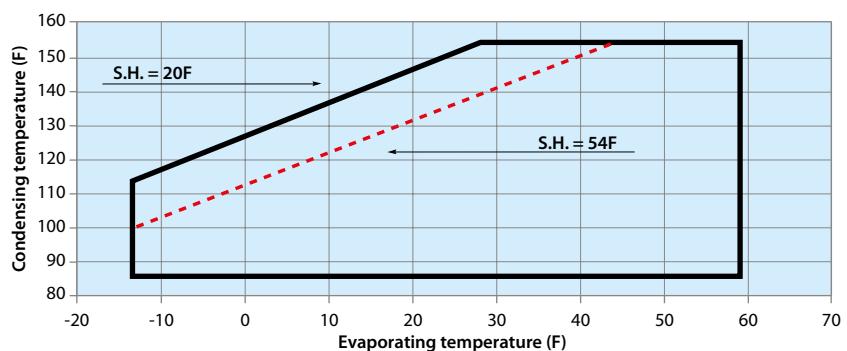
Controls Manufacturers

ARI: Air Conditioning and Refrigeration Institute


## Application guidelines

## Operating envelopes


**MT - R22**




**MTZ - R407C at DEW point**

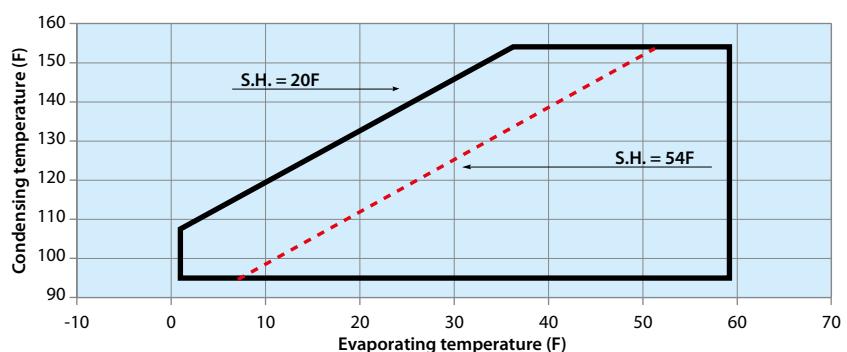


**MTZ - R134a**

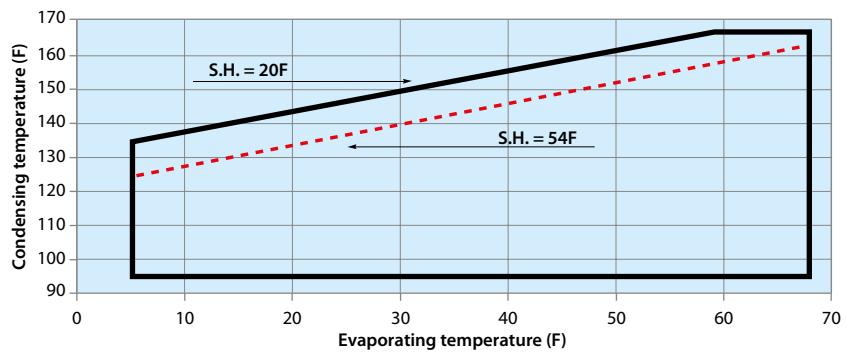


**MTZ - R404A / R507A**

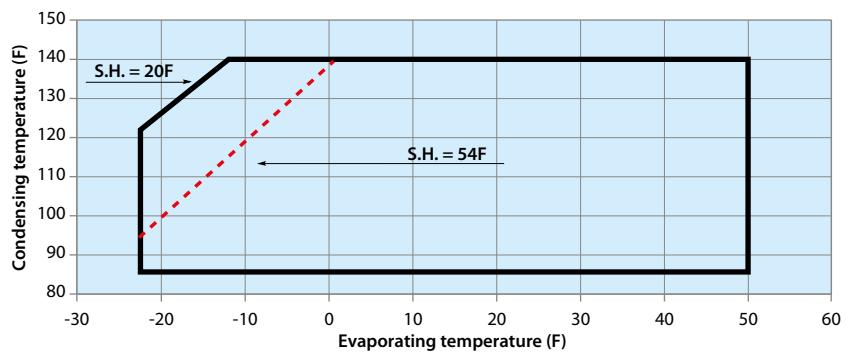

Application guidelines	Operating envelopes
<b>Zeotropic refrigerant mixtures</b>	<p>Refrigerant mixtures can be either zeotropic or azeotropic.</p>
	<p>An azeotropic mixture (like R502 or R507A) behaves like a pure refrigerant. During a phase transition (from vapor to liquid or from liquid to vapor) the composition of vapor and liquid stays the same.</p>
	<p>In a zeotropic mixture (like R407C) on the other hand the composition of vapor and</p>
<b>Phase shift</b>	<p>In system components where both vapor and liquid phase are present (evaporator, condenser, liquid receiver), the liquid phase and vapor phase do not have the same composition. In fact both phases form two different refrigerants. Therefore zeotropic refrigerants need some special attention. Zeotropic refrigerants must always be charged in liquid phase. Flooded evaporators and suction accumulators should not be applied in systems with zeotropic refrigerants. This also applies to near-azeotropic mixtures.</p>
<b>Temperature glide</b>	<p>During the evaporating process and the condensing process at constant pressure, the refrigerant temperature will decrease in the condenser and rise in the evaporator. Therefore when speaking about evaporating and condensing temperatures, it is important to indicate whether this is a dew point temperature or a mean point value. In the figure below, the dotted lines are lines of constant temperature.</p>
	<p>They do not correspond to the lines of constant pressure.</p>
	<p>Points A and B are dew point values. These are temperatures on the saturated vapor line.</p>
<b>Dew temperature and Mean temperature for R407C</b>	<p>Points C and D are mean point values. These are temperatures which correspond more or less with the average temperature during the evaporating and condensing process. For the same R407C cycle, mean point temperatures are typically about 3.6 to 5.4°F lower than dew point temperatures. According to Asercom recommendations, Danfoss Commercial Compressors uses dew point temperatures for selection tables and application envelopes etc.</p>
	<p>To obtain exact capacity data at mean point temperatures, the mean point temperatures must be converted to dew point temperatures with help of refrigerant data tables from the refrigerant manufacturer.</p>



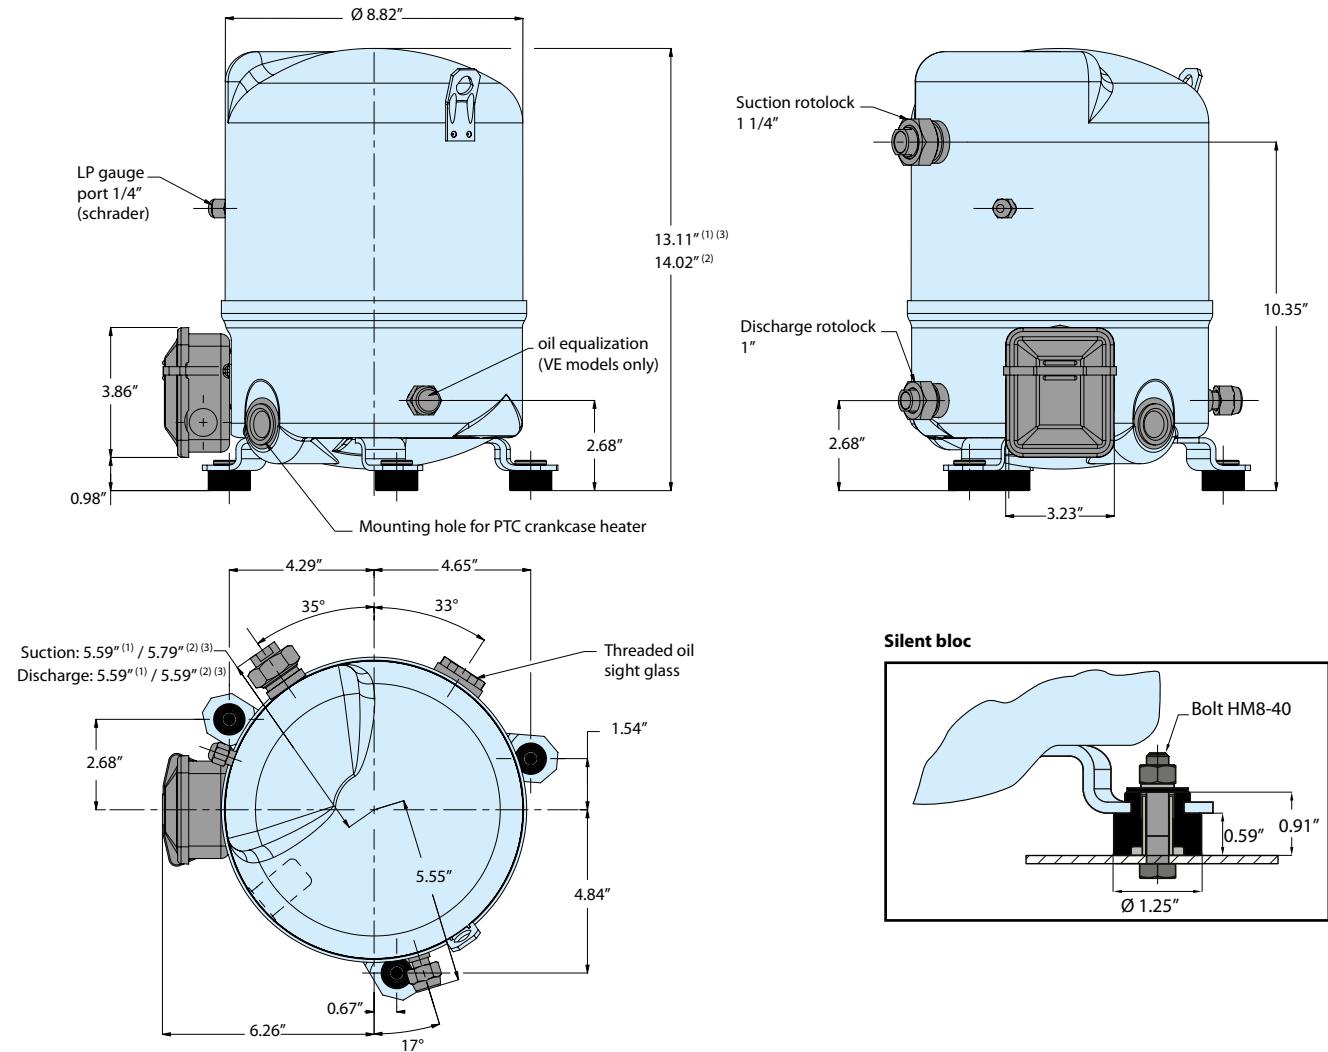
**1 cylinder**

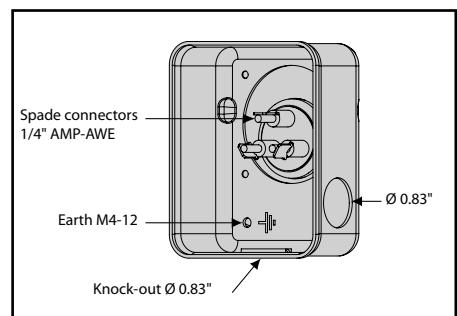
- (1) MT/MTZ 18-1/3/4/5/6, 22 & 28-3/4/5/6/7/9  
 (2) MT/MTZ 28-1, 32 & 36, 40-1/3/4/6  
 (3) MT/MTZ 22-1



**Terminal box**


IP rating: 55 (with cable gland)


	Rotolock connections size		Pipe sizing		Rotolock valve	
	Suction	Discharge	Suction	Discharge	Suction	Discharge
MT/MTZ 018 - 022 (3/4/5/6) - 028 (3/4/5/6)	1"	1"	1/2"	3/8"	V06	V01
MT/MTZ022 (1) - 028 (1) - 032 - 036 - 040	1 1/4"	1"	5/8"	1/2"	V09	V06

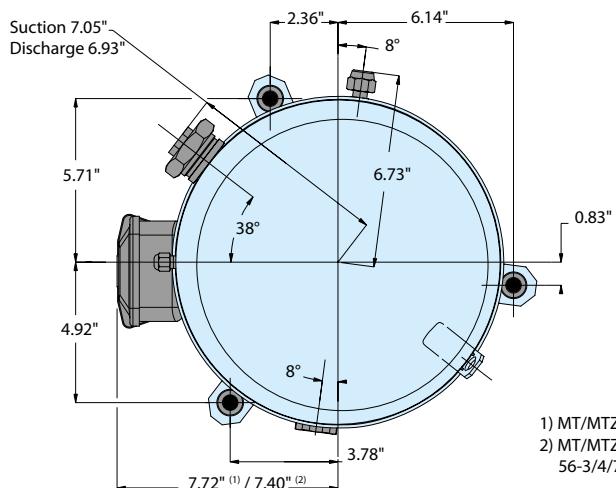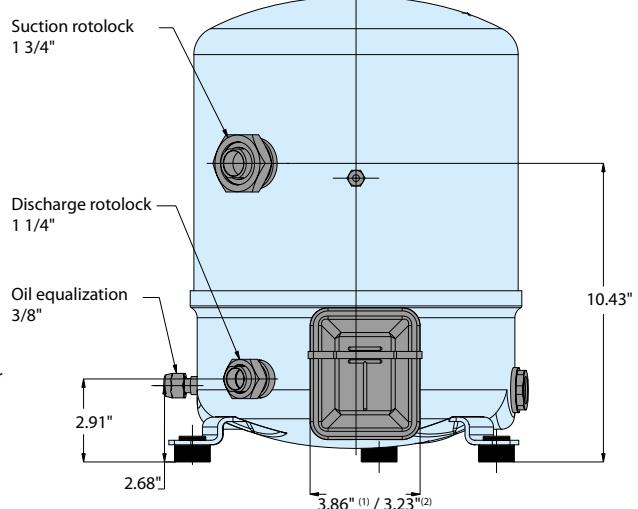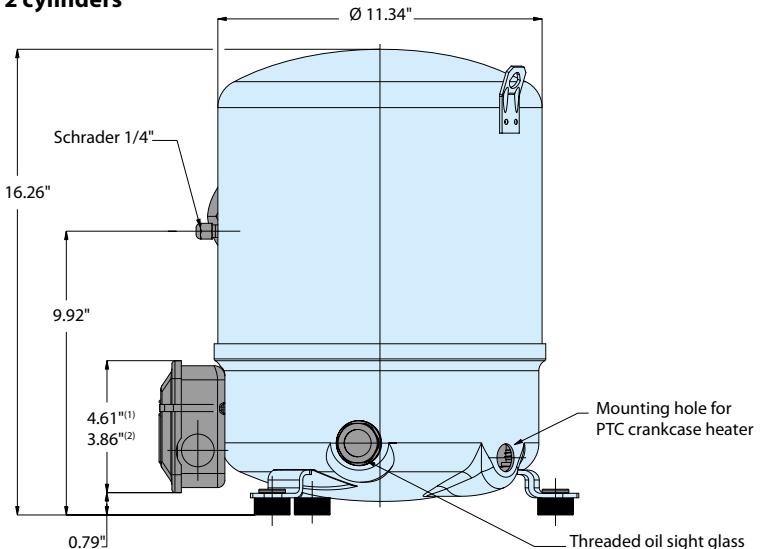**Application guidelines**
**Outline drawings**
**2 cylinders**

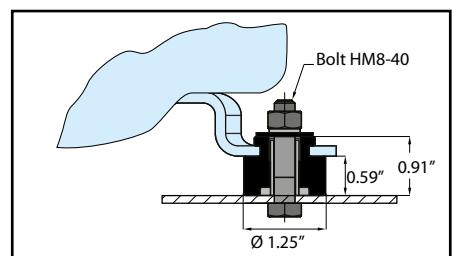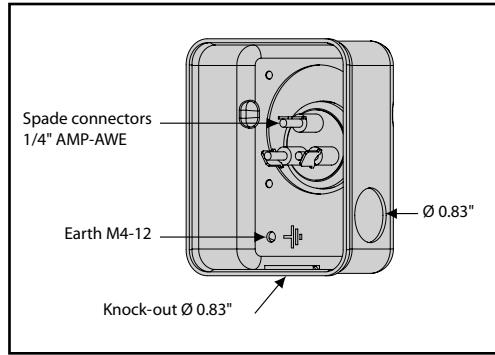
- 1) MT/MTZ 44-6, 50 - 56/64-1/6, 72-6, 80-3/6, 81-3  
2) MT/MTZ 44-1/3/4/7/9, 45/51/57/ 65/73 -3/4, 50-3/4/5/7/9,  
56-3/4/7/9, 64/72-3/4/9, 80-4/9,81-4




**Silent bloc**

**Terminal box for model (1)**

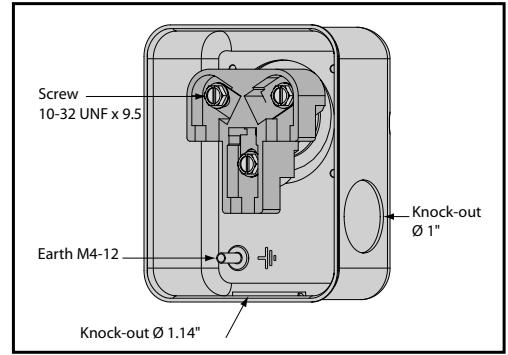
IP rating: 55 (with cable gland)



**Terminal box for model (2)**

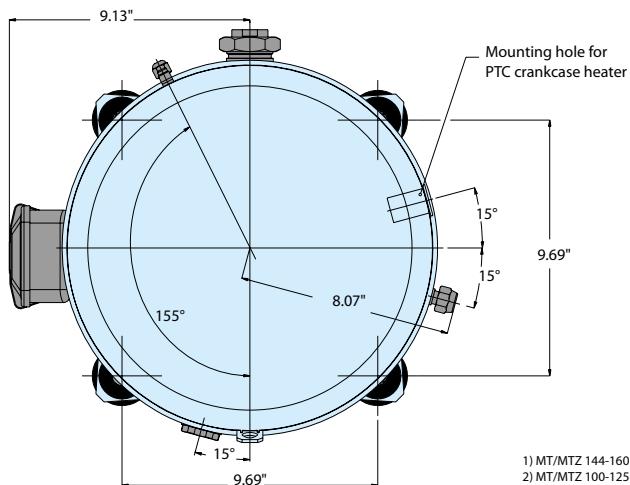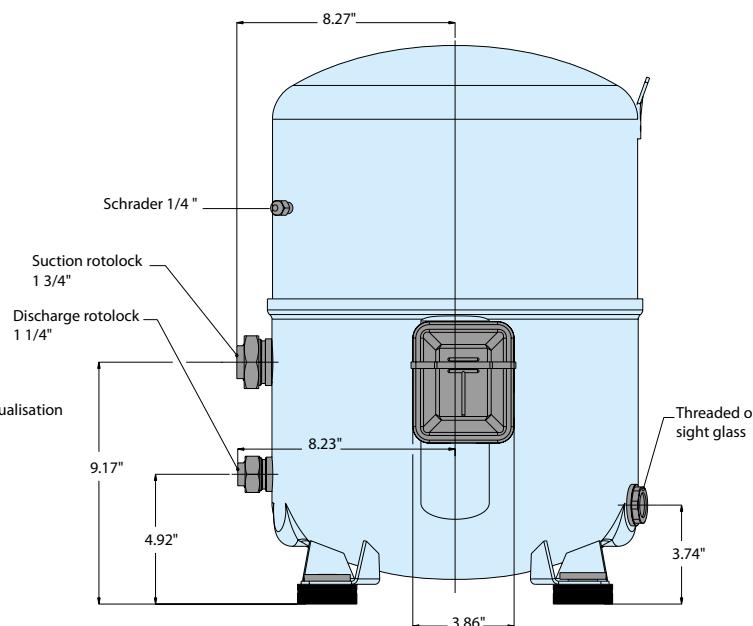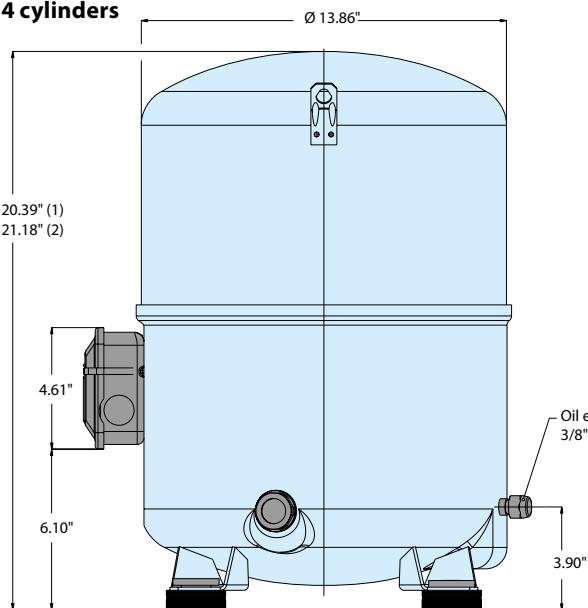
IP rating: 54 (with cable gland)

	Rotolock connections size		Pipe sizing		Rotolock valve	
	Suction	Discharge	Suction	Discharge	Suction	Discharge
<b>MT/MTZ044 - 045 - 050 - 051 - 056 - 057 - 064 - 065 - 072 - 073</b>	1 3/4"	1 1/4"	7/8"	3/4"	V07	V04
<b>MT/MTZ080 - 081</b>	1 3/4"	1 1/4"	1 1/8"	3/4"	V02	V04

**Application guidelines**
**Outline drawings**
**4 cylinders**

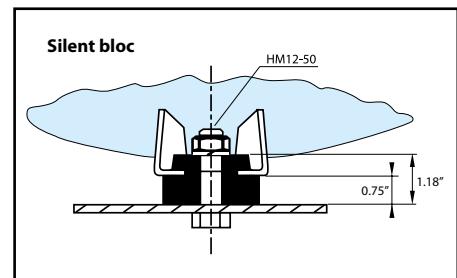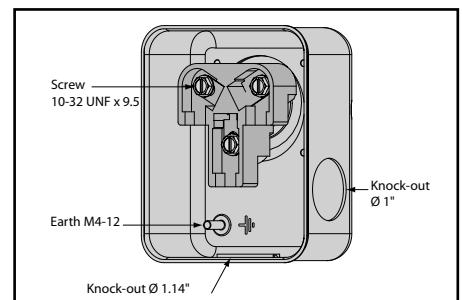
1) MT/MTZ 144-160 3/4/6/7/9  
2) MT/MTZ 100-125 3/4/6/7/9


**Terminal box**


IP rating: 54 (with cable gland)

	Rotolock connections size		Pipe sizing		Rotolock valve	
	Suction	Discharge	Suction	Discharge	Suction	Discharge
MT/MTZ100 - 125 - 144 - 160	1 3/4"	1 1/4"	1 1/8"	3/4"	V02	V04

## Application guidelines

## Electrical connections and wiring

### Single phase electrical characteristics

Motor Code	LRA - Locked Rotor Current (A)		MCC - Maximum Continuous Current (A)		Winding resistance (Ω) (± 7 % at 68° F)			
	1	5	1	5	1	5	run	start
<b>MT/MTZ018</b>	51	40	13	10	1.36	4.82	1.80	4.70
<b>MT/MTZ022</b>	49.3	41	17	15	1.25	2.49	1.78	4.74
<b>MT/MTZ028</b>	81	51	25	20	0.74	1.85	1.16	3.24
<b>MT/MTZ032</b>	84	70	26.5	20	0.64	2.85	0.90	4.30
<b>MT/MTZ036</b>	84	60	30	22	0.64	2.85	0.89	4.35
<b>MT/MTZ040</b>	99	-	34	-	0.53	2.00	-	-
<b>MT/MTZ044</b>	97	-	31	-	0.45	1.90	-	-
<b>MT/MTZ050</b>	114	92	36	29	0.37	1.79	0.52	2.65
<b>MT/MTZ056</b>	136	-	42.5	-	0.32	1.61	-	-
<b>MT/MTZ064</b>	143	-	46	-	0.32	2.10	-	-

### Nominal capacitor values and relays

Models	PSC/CSR*		CSR only		Start relay	
	Run capacitors (1)		Start capacitors (2)			
	(A) µF	(C) µF	(B) µF			
<b>50 Hz</b>	<b>MT/MTZ018 JA-5</b>	20	10	100	3ARR3J4A4 /RVA6AMKL	
	<b>MT/MTZ022 JC-5</b>	20	10	100		
	<b>MT/MTZ028 JE-5</b>	20	10	100		
	<b>MT/MTZ032 JF-5</b>	25	10	135		
	<b>MT/MTZ036 JG-5</b>	25	10	135		
	<b>MT/MTZ050 HK-5</b>	30	15	135		
<b>60 Hz</b>	<b>MT/MTZ018 JA-1</b>	15	10	100	3ARR3J4A4 /RVA6AMKL	
	<b>MT/MTZ022 JC-1</b>	30	15	100		
	<b>MT/MTZ028 JE-1</b>	25	25	135		
	<b>MT/MTZ032 JF-1</b>	25	20	100		
	<b>MT/MTZ036 JG-1</b>	25	20	100		
	<b>MT/MTZ040 JH-1</b>	35	20	100		
	<b>MT/MTZ044 HJ-1</b>	30	15	135		
	<b>MT/MTZ050 HK-1</b>	30	15	135		
	<b>MT/MTZ056 HL-1</b>	35	20	200		
	<b>MT/MTZ064 HM-1</b>	30	25	235		

\* PSC: Permanent Split Capacitor  
 CSR: Capacitor Start Run  
 (1) Run capacitors: 440 volts  
 (2) Start capacitors: 330 Volts

### Trickle circuit

The trickle circuit provides the facility of heating the compressor crankcase by feeding a small current to the auxiliary winding and the run capacitor (See the drawings page 14.)

By using PSC or CSR starting systems, compressor models MT / MTZ 018 - 022 can be

operated without crankcase heaters as the heater function is provided by the trickle circuit.

For the larger single phase compressor models MT / MTZ 028 - 064, the use of the PTC crankcase heater is recommended.

### PSC wiring

PSC wiring may be used for refrigerant circuits with capillary tubes or expansion valves with bleed ports. Pressure equalization must

be ensured before start-up because of the low starting torque characteristics of this system.

### CSR wiring

CSR wiring provides additional motor torque at start-up, by the use of a start capacitor in combination with the run capacitor. This system can be used for refrigerant circuits with capillary tubes or expansion valves. The start capacitor is only connected during the starting operation, a potential relay is used to disconnect it after the start sequence.

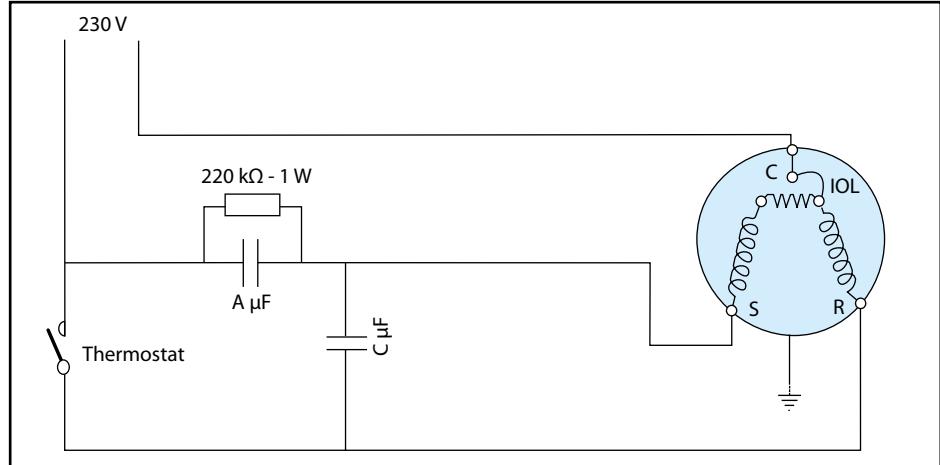
sensing bimetallic protector, which senses the main and start winding currents, and also the winding temperature. Once the protector has tripped, it may take up to two to four hours to reset and restart the compressor.

The single phase compressor motors are internally protected by a temperature/current


Check that power supply corresponds to compressor characteristics (refer to compressor nameplate).

**Suggested wiring diagrams**
**Single phase - PSC wiring with trickle circuit**


IOL Motor protector  
 A & C Run capacitors  
 C Common  
 S Start winding (auxiliary)  
 R Run winding (main)


**Single phase - CSR wiring with trickle circuit**

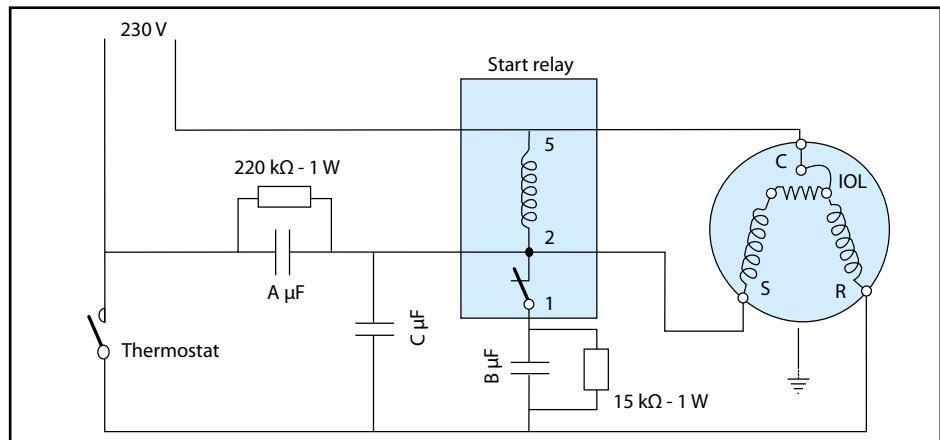IOL Motor protector  
 A & C Run capacitors  
 B Start capacitor  
 C Common  
 S Start winding (auxiliary)  
 R Run winding (main)


**Single phase - CSR wiring without trickle circuit**

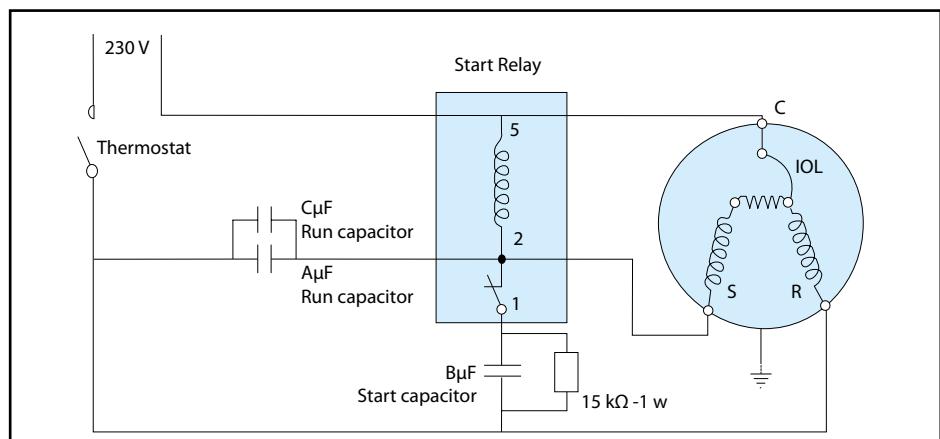IOL Motor protector  
 A+C Run capacitors  
 B Start capacitor  
 C Common  
 S Start winding (auxiliary)  
 R Run winding (main)  
 Capacitors A and C can be replaced by a single capacitor of size A + C



**Three phase electrical characteristics**

Motor Code	LRA - Locked Rotor Current (A)					MCC - Maximum Continuous Current (A)					Winding resistance (Ω) (± 7 % at 68°F)				
	3	4	6	7	9	3	4	6	7	9	3	4	6	7	9
MT/MTZ018	38	20	-	-	-	9	5	-	-	-	2.49	10.24	-	-	-
MT/MTZ022	38	16	30	-	22.5	11	6	8.5	-	6	2.49	10.24	3.38	-	6.58
MT/MTZ028	57	23	41	-	32	16	7.5	11.5	-	8.5	1.37	7.11	3.38	-	4.80
MT/MTZ032	60	25	44	22	35	18	8	13	5.5	9	1.27	6.15	1.27	8.90	4.20
MT/MTZ036	74	30	74	26	35	17	9	17	7	9.5	1.16	5.57	1.16	8.60	4.10
MT/MTZ040	98	38	74	-	-	22	10	18	-	-	0.95	4.56	0.95	-	-
MT/MTZ044	115	42	77	44	78	22	9.5	16	8.5	13	0.74	3.80	1.13	5.83	1.68
MT/MTZ045	115	48.5	-	-	-	17	9.5	-	-	-	0.69	3.22	-	-	-
MT/MTZ050	115	42	77	44	78	25	12	19	10	13.5	0.72	3.80	1.39	5.83	1.68
MT/MTZ051	120	48.5	-	-	-	22	11.5	-	-	-	0.69	3.60	-	-	-
MT/MTZ056	130	60	105	50	72	26	12	23	11	15	0.57	2.41	0.76	3.86	1.64
MT/MTZ057	130	64	-	-	-	24	12	-	-	-	0.55	2.39	-	-	-
MT/MTZ064	137	67	124	-	72	29	15	25	-	17.5	0.57	2.41	0.76	-	1.64
MT/MTZ065	135	64	-	-	-	28	14	-	-	-	0.55	2.39	-	-	-
MT/MTZ072	135	80	143	-	100	30	15.5	27	-	18.5	0.55	1.90	0.56	-	1.32
MT/MTZ073	155	80	-	-	-	32	17	-	-	-	0.48	1.90	-	-	-
MT/MTZ080	140	80	132	-	102	36	18	29	-	22.5	0.48	1.90	0.56	-	1.30
MT/MTZ081	140	80	-	-	-	36	19	-	-	-	0.48	1.90	-	-	-
MT/MTZ100	157	90	126	62	110	43	22	35	17	26	0.50	1.85	0.67	3.10	1.26
MT/MTZ 125	210	105	170	75	150	54	27	43	22	30	0.38	1.57	0.43	2.51	0.84
MT/MTZ 144	259	115	208	90	165	64	30	51	25	40	0.27	1.19	0.37	2.00	0.72
MT/MTZ 160	259	140	208	99	165	70	36	51	29	46	0.27	1.10	0.37	1.76	1.10

**Motor protection and suggested wiring diagrams**


The 3-phase compressors are protected by an internal motor protector, connected to the neutral point of the star connected stator windings, the protector cuts out all 3-phases simultaneously.

Note: once the overload protector has tripped it may take up to 3 hours to reset and restart the compressor.

For all 3-phase compressors, a PTC crankcase heater is required.

**Suggested wiring diagram with pump-down cycle and safety lock-out relay**

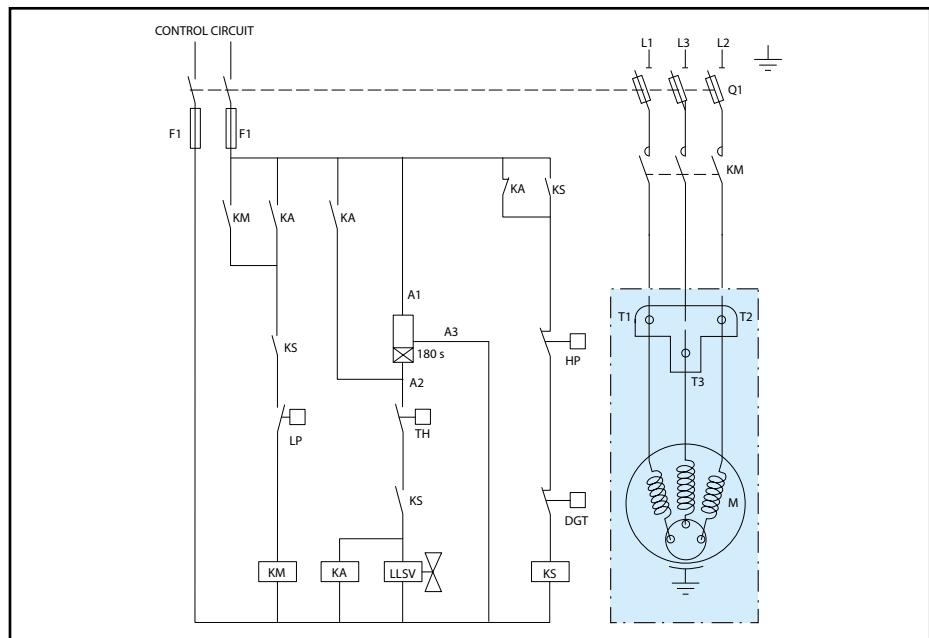- Control device ..... TH
- Optional short cycle timer (3 min) .... 180 s
- Control relay ..... KA
- Liquid Solenoid valve ..... LLSV
- Compressor contactor ..... KM
- Safety lock out relay ..... KS
- Pump-down control & LP switch ..... LP
- H.P. switch ..... HP
- Fused disconnect ..... Q1
- Fuses ..... F1
- Compressor motor ..... M
- Discharge gas thermostat ..... DGT




## Application guidelines

## Electrical connections and wiring

### Wiring diagram without pump-down cycle

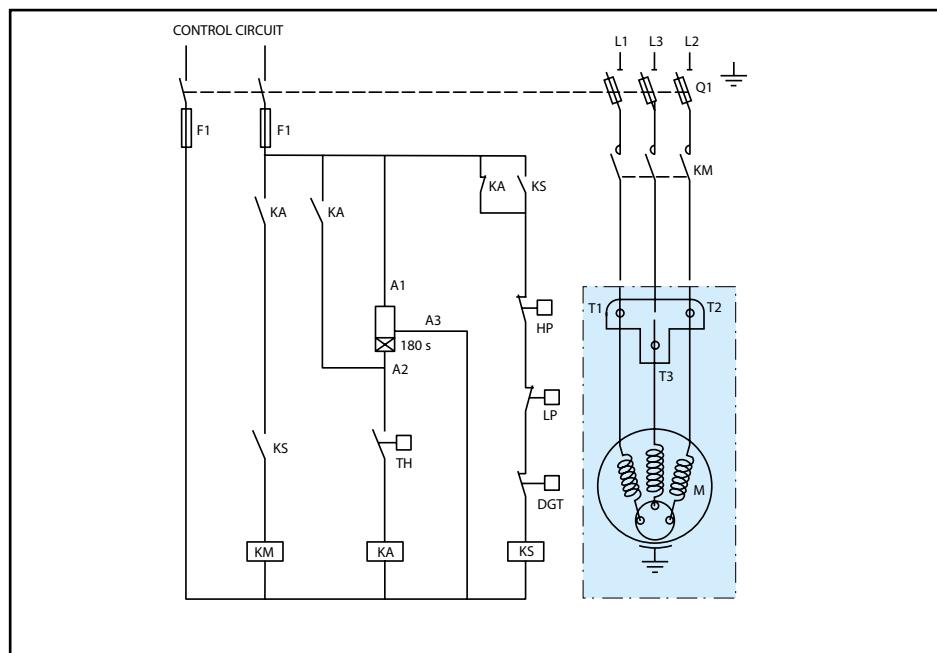Control device	..... TH
Optional short cycle timer (3 min)	.... 180 s
Control relay	..... KA
Compressor contactor	..... KM
Safety lock out relay	..... KS
High pressure switch	..... HP
Low pressure switch	..... LP
Fused disconnect	..... Q1
Fuses	..... F1
Compressor motor	..... M
Discharge gas thermostat	..... DGT



### Soft starters

Starting current of Maneurop® 3-phase compressors can be reduced by using a soft starter. Two different versions are available: Cl-tronic™ soft starters type MCI (recommended) and soft start kits with statoric resistors type SCR. The starting current can be reduced by up to 50% depending on the compressor model and the type of soft starter. Also mechanical stresses that occur at starting are reduced which increases the life of the internal components.

For details of the Cl-tronic™ MCI soft starters, please refer to literature DKACT.PD.C50.

For details of the SCR soft start kits, please contact Danfoss.

The number of starts should be limited to 6 per hour. HP/LP pressure equalization is required before starting.

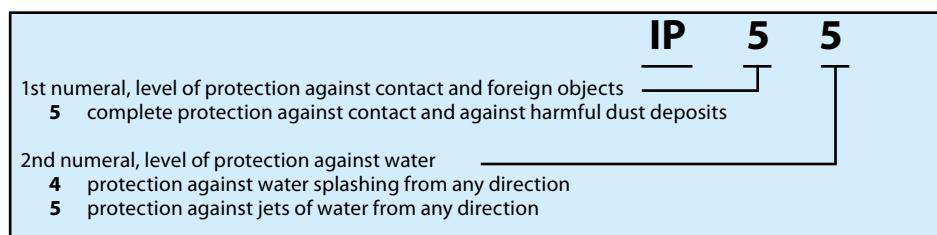
### Voltage application range

Motor Code	Nominal voltage	Voltage application range
1	208-230 V / 1 ph / 60 Hz	187 - 253 V
3	200-230 V / 3 ph / 60 Hz	180 - 253 V
4	380-400 V / 3 ph / 50 Hz	340 - 440 V
	460 V / 3 ph / 60 Hz	414 - 506 V
5	230 V / 1 ph / 50 Hz	207 - 253 V
6	230 V / 3 ph / 50 Hz	207 - 253 V
7	500 V / 3 ph / 50 Hz	450 - 550 V
	575 V / 3 ph / 60 Hz	517 - 632 V
9	380 V / 3 ph / 60 Hz	342 - 418 V

### IP rating

The compressor terminal boxes IP rating according to CEI 529 are shown on the outline drawings section.

The IP ratings are only valid when correctly sized cable glands of the same IP rating are applied.



## Application guidelines

## Refrigerants and lubricants

### General information

When choosing a refrigerant, different aspects must be taken into consideration:

- Legislation (now and in the future)
- Safety
- Application envelope in relation to expected running conditions
- Compressor capacity and efficiency
- Compressor manufacturer recommendations & guidelines

Additional points could influence the final choice:

- Environmental considerations
- Standardization of refrigerants and lubricants
- Refrigerant cost
- Refrigerant availability

The table below gives an overview of the different refrigerant - lubricant - compressor combinations for Maneurop®, MT & MTZ compressors.

Refrigerant	Type	Lubricant type	Compressor type	Danfoss lubricant	Application
R22	HCFC	Mineral	MT	White oil, <b>160P</b>	Medium / High temperature
R407C	HFC	Polyolester	MTZ	Polyolester oil <b>160PZ</b>	Medium / High temperature
R134a	HFC	Polyolester	MTZ	Polyolester oil <b>160PZ</b>	Medium / High temperature
R404A	HFC	Polyolester	MTZ	Polyolester oil <b>160PZ</b>	Medium temperature
R507A	HFC	Polyolester	MTZ	Polyolester oil <b>160PZ</b>	Medium temperature
<b>Transitional refrigerants, R22 based</b>		Alkylbenzene (ABM)	MT	Alkylbenzene oil <b>160 ABM</b> <b>Note:</b> Initial mineral oil charge has to be replaced by 160 ABM oil.	Medium / High temperature
<b>Hydrocarbons</b>				Danfoss does not authorize the use of hydrocarbons in Maneurop® MT/MTZ compressors	

The Montreal protocol states that CFC refrigerants such as R12 and R502 may no longer be applied in new installations in the signatory members countries.

Therefore capacity and other data for these refrigerants are not published in this document. Maneurop® MT compressors however are suitable for use with these refrigerants and can still be used as replacements in existing installations.

### R22

R22 is an HCFC refrigerant and is still a wide use today. It has a low ODP (Ozone Depletion Potential) and therefore it will be phased out in the future. Check local legislation. Always use mineral white oil 160P.

The Maneurop® MT compressor is dedicated for R22 and is supplied with an initial mineral oil charge.

### R407C

Refrigerant R407C is an HFC refrigerant with similar thermodynamic properties to those of R22.

"mixtures". R407C must be charged in the liquid phase.

R407C has zero ozone depletion potential (ODP=0). Many installers and OEMs consider R407C to be the standard alternative for R22. R407C is a zeotropic mixture and has a temperature glide of about 11°F. For more specific information about zeotropic refrigerants; refer to section "zeotropic refrigerant

Always use the Maneurop® MTZ compressors with Danfoss 160PZ polyolester oil, which is supplied with the MTZ compressor for R407C applications.

Maneurop® MT compressors should never be used with R407C, even when the mineral oil is replaced with polyolester oil.

Application guidelines	Refrigerants and lubricants	
<b>R134a</b>	<p>Refrigerant R134a is an HFC refrigerant with thermodynamic properties comparable to those of the CFC refrigerant R12. R134a has zero ozone depletion potential (ODP = 0) and is commonly accepted as the best R12 alternative. For applications with high evaporating and high condensing temperatures, R134a is the ideal choice. R134a is a pure refrigerant and has zero temperature glide. For R134a</p>	<p>applications always use the Maneurop® MTZ compressor with Danfoss 160PZ polyolester oil which is supplied with the MTZ compressor.</p> <p>Maneuprop® MT compressors should never be used for R134a, even when the mineral oil is replaced by polyolester oil.</p>
<b>R404A</b>	<p>Refrigerant R404A is an HFC refrigerant with thermodynamic properties comparable to those of the CFC refrigerant R502. R404A has zero ozone depletion potential (ODP = 0) and is commonly accepted as one of the best R502 alternatives. R404A is especially suitable for low evaporating temperature applications but it can also be applied to medium evaporating temperature applications. R404A is a mixture and has a very small temperature glide, and therefore must be charged in its liquid phase, but for most other aspects this small glide can be neglected. Because of the small glide, R404A is often called a near-azeo-</p>	<p>tropic mixture. For more information refer to section "zeotropic refrigerant mixtures". For low evaporating temperature applications down to -49°F, Maneurop® NTZ compressors should be used. Refer to the NTZ selection and application guidelines. For medium temperature R404A applications, always use the Maneurop® MTZ compressor with 160PZ polyolester oil which is supplied with the MTZ compressor.</p> <p>Maneuprop® MT compressors should never be used for R404A, even with the mineral oil replaced by polyolester oil.</p>
<b>R507A</b>	<p>Refrigerant R507A is an HFC refrigerant with thermodynamic properties comparable to those of the CFC refrigerant R502 and virtually equal to those of R404A. R507A has no ozone depletion potential (ODP = 0) and is commonly accepted as one of the best R502 alternatives. As with R404A, R507A is particularly suitable for low evaporating temperature applications but it can also be used for medium evaporating temperature applications. R507A is an azeotropic mixture with no temperature glide. For low evaporating tem-</p>	<p>perature applications down to -49°F, Maneurop® NTZ compressor should be used. Refer to the NTZ selection and application guidelines. For medium temperature R507A applications, always use the Maneurop® MTZ compressor and Maneurop® 160PZ polyolester oil which is supplied with the MTZ compressor.</p> <p>Maneuprop® MT compressors should never be used for R507A, even with the mineral oil replaced by polyolester oil.</p>
<b>R22 based transitional refrigerants</b>	<p>A wide variety of R22 based transitional refrigerants exist (also called service refrigerants or drop-in blends). These were developed as temporary R12 or R502 alternatives. Some examples are R401A, R401B, R409A and R409B as R12 alternatives and R402A, R402B, R403A and R403B as R502 alternatives. Be-</p>	<p>cause of the R22 component, they all have a (low) ozone depletion potential. Maneurop® MT compressors can be applied with these transitional refrigerants. The initial mineral oil charge must be replaced by Maneurop® 160 ABM alkylbenzene oil.</p>
<b>Hydrocarbons</b>	<p>Hydrocarbons such as propane, isobutane etc. are extremely flammable. Danfoss does not authorize the use of hydrocarbons with</p>	<p>Maneuprop® MT or MTZ compressors in any way, even with a reduced refrigerant charge.</p>

Application guidelines	System design recommendations
<b>Piping design</b>	<p>Oil in a refrigeration circuit is required to lubricate moving parts in the compressor. During normal system operation small oil quantities will continuously leave the compressor, with the discharge gas. With good system piping design this oil will return to the compressor. As long as the amount of oil circulating through the system is small it will contribute to good system operation and improved heat transfer efficiency. However, too large amounts of oil in the system will have a negative effect on condenser and evaporator efficiency. If, in a poorly designed</p>
<b>Suction lines</b>	<p>Horizontal suction line sections shall have a slope of 0.5% in the direction of refrigerant flow (5/8" per 10 ft of pipe). The cross-section of horizontal suction lines shall be such that the resulting gas velocity is at least 13 ft/s. In vertical risers, a gas velocity of 26 to 40 ft/s is required to ensure proper oil return. A U-trap is required at the foot of each vertical riser. If the riser is higher than 4 m, additional U-traps are required for each additional 4 meters. The length of each U-trap must be as short as possible to avoid the accumulation of excessive quantities of oil (see figure below).</p>
	<p>For compressors mounted in parallel, the common suction riser should be designed as a double riser. Also refer to the News bulletin "Mounting instructions for installation of Maneurop® compressors in parallel" and "Parallel application guidelines".</p>
<b>Discharge line</b>	<p>When the condenser is mounted above the compressor, a loop above the condenser and a U-trap close to the compressor are required to prevent liquid draining from the condenser into the discharge line during standstill.</p>
	<p>system, the amount of oil returning to the compressor is lower than the amount of oil leaving the compressor, the compressor will become starved of oil and the condenser, evaporator and/or refrigerant lines will become filled with oil. In such situations, additional oil charge will only correct the compressor oil level for a limited period of time and increase the amount of surplus oil in the rest of the system.</p>
	<p>Only correct piping design can ensure a good oil balance in the system.</p>
	<p>Gas velocities higher than 40 ft/s will not contribute to significantly better oil return. However they will cause higher noise levels and result in higher suction line pressure drops which will have a negative effect on the system capacity.</p>
	<p>Note that the suction rotolock valves, which can be ordered from Danfoss as accessories, are designed for average pipe sizes, selected for systems running at nominal conditions.</p>
	<p>The pipe sizes selected for specific systems may differ from these recommended sizes.</p>
	<p>It is recommended that the suction lines are insulated to limit suction gas superheat.</p>

Application guidelines	System design recommendations
<b>Oil charge and oil separator</b>	In most installations the initial compressor oil charge will be sufficient. In installations with line runs exceeding 66 ft, or with many oil traps or an oil separator, additional oil may be required.
<b>Filter driers</b>	For new installations with MTZ compressors Danfoss recommends using the Danfoss DML 100%-molecular sieve, solid core filter drier. Molecular sieve filter driers with loose beads from third party suppliers shall be avoided.
<b>Operating limits</b>	
<b>High pressure</b>	A high pressure safety switch is required to stop the compressor, should the discharge pressure exceed the values shown in the table below. The high pressure switch can be set to lower values depending on the application and ambient conditions. The HP switch must either be in a lockout circuit, or be a manual reset device to prevent compressor cycling around the high pressure limit. When a discharge valve is used, the HP switch must be connected to the service valve gauge port, which cannot be isolated.
<b>Low pressure</b>	A low pressure safety switch is recommended to avoid compressor operation at too lower suction pressures.
<b>Low ambient temperature operation</b>	<p>At low ambient temperatures, the condensing temperature and condensing pressure in air cooled condensers will decrease.</p> <p>This low pressure may be insufficient to supply enough liquid refrigerant to the evaporator. As a result the evaporator temperature will strongly decrease with the risk of frosting. At compressor start-up, the compressor can pull a deep vacuum and it can be switched off by the low pressure protection. Depending on the low pressure switch setting and delay timer, short cycling can occur. To avoid these problems, several solutions are possible, based on reducing condenser capacity:</p> <ul style="list-style-type: none"> <li>• Indoor location of condensers</li> <li>• Liquid flooding of condensers (note: this solution requires extra refrigerant charge, which can introduce other problems. A non-</li> </ul>
<p>return valve in the discharge line is required and special care should be taken when designing the discharge line.)</p> <ul style="list-style-type: none"> <li>• Reduce air flow to condensers.</li> </ul> <p>Other problems can also occur when the compressor is operating at low ambient temperature. During shut down periods, liquid refrigerant can migrate to a cold compressor.</p> <p>For such conditions a belt-type crankcase heater is strongly recommended.</p> <p>Note that with 100% suction gas cooled motors, Maneurop® compressors can be externally insulated.</p> <p>Refer to section "Liquid refrigerant migration &amp; charge limits" for more details.</p>	

Application guidelines	System design recommendations	
<b>Operating voltage and cycle rate</b>	<p>The operating voltage limits are shown in the table on page 4. The voltage applied to the motor terminals must always be within these table limits. The maximum allowable voltage unbalance for 3-phase compressors is 2%. Voltage unbalance causes high current draw on one or more phases, which in turn leads to overheating and possible motor damage.</p>	
<i>Operating voltage range</i>	<p>Voltage unbalance is given by the formula:</p> $\% \text{ voltage unbalance: } \frac{ V_{avg} - V_{1-2}  +  V_{avg} - V_{1-3}  +  V_{avg} - V_{2-3} }{2 \times V_{avg}} \times 100$ <p>V<sub>avg</sub> = Mean voltage of phases 1, 2 and 3  V<sub>1-2</sub> = Voltage between phases 1 and 2  V<sub>1-3</sub> = Voltage between phases 1 and 3  V<sub>2-3</sub> = Voltage between phases 2 and 3.</p>	
<i>Cycle rate limit</i>	<p>There may be no more than 12 starts per hour (6 when a soft start accessory is used). A higher number reduces the service life of the motor-compressor unit. If necessary, use an anti-short-cycle timer in the control circuit.</p>	<p>A time-out of six minutes is recommended. The system must be designed in such a way to guarantee a minimum compressor running time in order to provide proper oil return and sufficient motor cooling after starting.</p>
<b>Liquid refrigerant control and charge limit</b>	<p>Refrigeration compressors are basically designed as gas compressors. Depending on the compressor design and operating conditions, most compressors can also handle a limited amount of liquid refrigerant. Maneurop® MT and MTZ compressors have a large internal volume and can therefore handle relatively large amounts of liquid refrigerant without major problems. However even when a compressor can handle liquid refrigerant, this will not be favorable to its service</p>	<p>life. Liquid refrigerant can dilute the oil, wash oil out of bearings and result in high oil carry over, resulting in loss of oil from the sump. Good system design can limit the amount of liquid refrigerant in the compressor, which will have a positive effect on the compressor service life.</p>
<i>Off-cycle migration</i>	<p>During system standstill and after pressure equalization, refrigerant will condense in the coldest part of the system. The compressor can easily be the coldest spot, for example when it is placed outside in low ambient temperatures. After a while, the full system refrigerant charge can condense in the compressor crankcase. A large amount will dissolve in the compressor oil until the oil is completely saturated with refrigerant. If other system components are located at a higher level, this process can be even faster because gravity will assist the liquid refrigerant to flow back to the compressor. When the compressor is started, the pressure in the crankcase decreases rapidly.</p>	<p>At lower pressures the oil holds less refrigerant, and as a result part of the refrigerant will violently evaporate from the oil, causing the oil to foam. This process is often called "boiling".</p>
<i>Liquid floodback during operation</i>	<p>During normal and stable system operation, refrigerant will leave the evaporator in a superheated condition and enter the compressor as a superheated vapor.</p>	<p>The negative effects from migration on the compressor are:</p> <ul style="list-style-type: none"> <li>• oil dilution by liquid refrigerant</li> <li>• oil foam, transported by refrigerant gas and discharged into the system, causing loss of oil and in extreme situations risk for oil slugging</li> <li>• in extreme situations with high system refrigerant charge, liquid slugging could occur (liquid entering the compressor cylinders).</li> </ul>
	<p>Normal superheat values at compressor suction are 9 to 54°F. However the refrigerant leaving the evaporator can contain an amount of liquid refrigerant due to different reasons:</p>	

Application guidelines	System design recommendations	
<i>Liquid floodback at change over cycles in reversible heat pumps</i>	<ul style="list-style-type: none"> <li>• wrong dimensioning, wrong setting or malfunction of expansion device</li> <li>• evaporator fan failure or blocked air filters.</li> </ul> <p>In these situations, liquid refrigerant will continuously enter the compressor.</p>	<p>The negative effects from continuous liquid floodback are:</p> <ul style="list-style-type: none"> <li>• permanent oil dilution</li> <li>• in extreme situations with high system refrigerant charge and large amounts of floodback, liquid slugging could occur.</li> </ul>
<i>Liquid floodback and zeotropic refrigerants</i>	<p>In heat pumps, change over from cooling to heating cycles, defrost and low load short cycles may lead to liquid refrigerant floodback or saturated refrigerant return conditions.</p>	<p>The negative effects are:</p> <ul style="list-style-type: none"> <li>• oil dilution</li> <li>• in extreme situations with high system refrigerant charge and large amounts of floodback, liquid slugging could appear.</li> </ul>
<i>Crankcase heater</i>	<p>Liquid floodback in systems working with a zeotropic refrigerant such as R407C introduces additional negative effects. A part of the refrigerant leaves the evaporator in liquid phase and this liquid has a different</p> <p>A crankcase heater protects against the off-cycle migration of refrigerant and proves effective if oil temperature is maintained 18°F above the saturated LP temperature of the refrigerant. Tests must thereby be conducted to ensure that the appropriate oil temperature is maintained under all ambient conditions. A PTC crankcase heater is recommended on all stand-alone compressors and split systems. PTC crankcase heaters are self-regulating. Under extreme conditions, such as very low ambient temperature, a belt type crankcase heater could be used in addition to the PTC heater; although this is not a preferred solution for 1 and 2 cylinder compressors. The belt crankcase heater must be positioned on the compressor shell as close as possible to the oil sump to ensure good heat transfer to the oil.</p>	<p>composition than the vapor.</p> <p>This new refrigerant composition may result in different compressor operating pressures and temperatures.</p> <p>Belt crankcase heaters are not self-regulating. Control must be applied to energize the belt heater once the compressor has been stopped and then to de-energize it while the compressor is running. The belt heater must be energized 12 hours before restarting the compressor following an extended down period.</p>
<i>Liquid line solenoid valve &amp; pump-down</i>	<p>In refrigeration applications, the Liquid Line Solenoid Valve (LLSV) is highly recommended. During the off-cycle, the LLSV isolates the liquid charge in the condenser side, thus preventing against refrigerant transfer or excessive migration of refrigerant into the compressor. Furthermore, when using a LLSV</p>	<p>If the crankcase heater is not able to maintain the oil temperature at 18°F above the saturated LP temperature of the refrigerant during off cycles or if repetitive floodback is present a the Liquid Line Solenoid Valve (LLSV) + pump-down cycle is required, eventually in conjunction with a suction accumulator.</p>
<i>Suction accumulator</i>	<p>A suction accumulator offers considerable protection against refrigerant floodback at start-up, during operation or after the defrost operation. This device also helps to protect against off-cycle migration by means of providing additional internal free volume to the low pressure side of the system.</p> <p>The suction accumulator must be selected</p>	<p>in conjunction with a pump-down cycle, the quantity of refrigerant in the low-pressure side of the system will be reduced.</p> <p>A pump-down cycle design is required when evaporators are fitted with electric defrost heaters.</p> <p>in accordance with the accumulator manufacturer recommendations. As a general rule, Danfoss recommends to size the accumulator for at least 50% of the total system charge. Tests however must be conducted to determine the optimal size.</p>
		<p>A suction accumulator shall not be used in systems with zeotropic refrigerant mixtures.</p>

Application guidelines		Sound and vibration management			
<b>Sound</b>		<p>Running compressors cause sound and vibration. Both phenomena are closely related.</p> <p>Sound produced by a compressor is transmitted in every direction by the ambient air, the mounting feet, the pipework and the refrigerant in the pipework.</p> <p>The easiest way to reduce the sound transmitted through ambient air is to fit a Danfoss acoustic hood accessory.</p>			
		<p>Because Maneurop® compressors are 100% suction gas cooled, and require no body cooling, they can be insulated. Values for the sound reduction achieved with acoustic hoods are shown also in the table below. For inside mounted compressors, sound insulation of the plantroom is an alternative to sound insulation of the compressor.</p> <p>Sound transmitted by mounting feet, pipework and refrigerant should be treated the same way as for vibration. Please refer to the next section.</p>			
		Sound power level at 50 Hz dB(A)	Sound power level at 60 Hz dB(A)	Acoustic hood accessory	
		without hood	with hood*	without hood	with hood*
<b>MTZ018</b>		73	65	73	66
<b>MTZ022</b>		74	68	77	71
<b>MTZ028</b>		71	64	73	66
<b>MTZ032</b>		71	64	73	66
<b>MTZ036</b>		70	64	76	69
<b>MTZ040</b>		70	65	72	67
<b>MTZ044</b>		80	74	82	76
<b>MTZ045</b>		80	74	82	76
<b>MTZ050</b>		83	76	84	78
<b>MTZ051</b>		83	76	84	78
<b>MTZ056</b>		81	74	81	74
<b>MTZ057</b>		81	74	81	74
<b>MTZ064</b>		80	74	84	78
<b>MTZ065</b>		80	74	84	78
<b>MTZ072</b>		79	72	82	75
<b>MTZ073</b>		79	72	82	75
<b>MTZ080</b>		79	73	84	78
<b>MTZ081</b>		79	73	84	78
<b>MTZ100</b>		85	79	87	81
<b>MTZ125</b>		84	78	86	80
<b>MTZ144</b>		83	77	86	80
<b>MTZ160</b>		83	77	86	80

Sound power level for MTZ with R404A, motor code 4      Te = 14°F, Tc= 113°F  
 \* Sound data with hood are valid for the Danfoss acoustic hood accessory.  
 As first approach, use these figures with -3 dBA reduction for MT models applied with R22.

## Vibration

The mounting grommets delivered with the compressor should always be used. They reduce the vibration transmitted by the compressor mounting feet to the base frame.

The base on which the compressor is mounted should be sufficiently rigid and of adequate mass to ensure the full effectiveness of the mounting grommets.

The compressor should never be directly mounted to the base frame without the grommets, otherwise high vibration transmission would occur and the compressor service life reduced. Suction and discharge lines must have adequate flexibility in 3 planes. Eventually vibration absorbers may be required.

Care must be taken to avoid tubing having resonant frequencies close to those of the compressor frequency.

Vibration is also transmitted by the refrigerant gas. Maneurop® compressors have built in mufflers to reduce this vibration.

To further reduce vibration an extra muffler can be installed.

Note: Maneurop® MT & MTZ compressors have been designed and qualified for stationary equipment used in A/C and Refrigeration applications. Danfoss doesn't warrant these compressors for use in mobile applications, such as trucks, railways, subways, etc...

Application guidelines	Installation and service
<b>System cleanliness</b>	<p>System contamination is one of the main factors affecting equipment reliability and compressor service life.</p> <p>Therefore it is important to ensure system cleanliness when manufacturing a refrigeration system. During the manufacturing process, system contamination can be caused by:</p> <ul style="list-style-type: none"> <li>• Brazing and welding oxides</li> <li>• Filings and particles from removing burrs from pipe-work</li> <li>• Brazing flux</li> <li>• Moisture and air.</li> </ul> <p>Only use clean and dehydrated refrigeration grade copper tubes and silver alloy brazing</p> <p>material. Clean all parts before brazing and always purge nitrogen or CO<sub>2</sub> through the pipes during brazing to prevent oxidation. If flux is used, take every precaution to prevent leakage into the piping. Do not drill holes (e.g. for schrader valves) in parts of the installation that are already completed, when filings and burrs can not be removed. Carefully follow the instructions below regarding brazing, mounting, leak detection, pressure test and moisture removal. All installation and service work shall only be done by qualified personnel respecting all procedures and using tools (charging systems, tubes, vacuum pump, etc.) dedicated for the refrigerant that will be used.</p>
<b>Compressor handling, mounting and connection to the system</b>	<p><b>Compressor handling</b></p> <p>Maneurop® MT and MTZ compressors are provided with a lifting lug. This lug should always be used to lift the compressor. Once the compressor is installed, the compressor lifting lug should never be used to lift the complete installation.</p> <p>Keep the compressor in an upright position during handling.</p>
<b>Compressor mounting</b>	<p>Mount the compressor on a horizontal plane with a maximum slope of 3 degrees. All compressors are supplied with three or four rubber mounting grommets, each complete with metal sleeves and nuts and bolts. Refer to the outline drawings on page 10 to 12.</p> <p>These grommets largely attenuate the compressor vibration transmitted to the base frame. The compressor must always be mounted with these grommets. Refer to the table below for torque values.</p>
<b>Compressor connection to the system</b>	<p>New compressors have a protective nitrogen holding charge. The suction and discharge caps should only be removed just before connecting the compressor to the installation to avoid air and moisture entering the compressor.</p> <p>Whenever possible the compressor must be the last component to be integrated into the system. It is advisable to braze the solder sleeves or service valves to the pipework</p> <p>before the compressor is mounted. When all brazing is finished and when the total system is ready, the compressor caps can be removed and the compressor can be connected to the system with a minimum exposure to ambient air.</p> <p>If this procedure is not possible, the sleeves or valves may be brazed to the pipes when mounted on the compressor.</p>

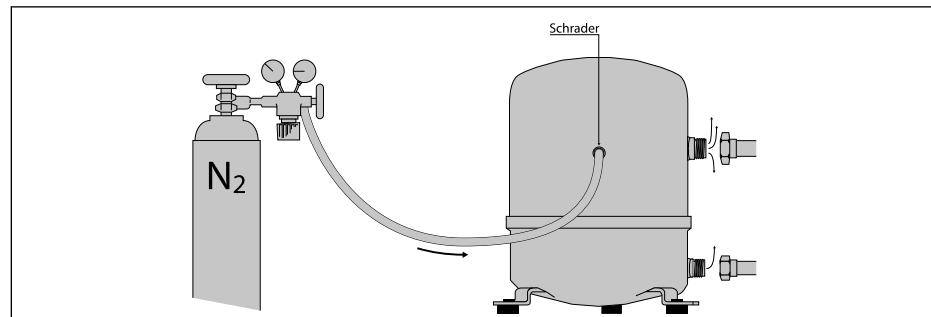
## Application guidelines

## Installation and service

In this situation nitrogen or CO<sub>2</sub> must be purged through the compressor via the schrader valve to prevent air and moisture ingress. Purging must start when the caps are removed and proceeded during the brazing process.

When rotolock valves are used on the compressor, they shall be closed immediately after mounting, thus keeping the compressor isolated from atmosphere or from a not yet dehydrated system.

Note: When the compressor is built into a "pack" or "rack" configuration which is not installed immediately on its final location, a vacuum pull-down and moisture removal must be performed to this pack (rack) as if it were a complete system (see below). The pack must be charged with nitrogen or CO<sub>2</sub> and open tubes must be blocked with caps or plugs.



### System pressure test

It is recommended that an inert gas such as nitrogen be used for pressure testing. Dry air may also be used but care should be taken since it can form an inflammable mixture with the compressor oil. When performing a system pressure test, the maximum allowed pressure for the different components should not be exceeded.

For MT/MTZ compressors the maximum test pressures are shown in the table beside.

	1-2-4 cylinder compressors
Maximum compressor test pressure, low side	362 psi(g)
Maximum compressor test pressure, high side	435 psi(g)

Do not exceed 435 psig pressure difference between high pressure side and low pressure side of the compressor because this will open the internal compressor relief valve.

### Leak detection

Whenever possible (if valves are present) the compressor must be kept isolated from the system. Perform a leak detection using the final refrigerant. Pressurize with nitrogen or another neutral gas and use a leak detector for the applied refrigerant. Any spectrometric detection system using helium can also be applied.

Eventual leaks shall be repaired respecting the instructions written above. It is not recommended to use other gasses such as oxygen, dry air or acetylene as these gasses can form an inflammable mixture. Never use

CFC or HCFC refrigerants for leak detection of HFC systems.

Note 1: Leak detection with refrigerant may not be allowed in some countries. Check local regulations.

Note 2: Leak detecting additives shall not be used as they may affect the lubricant properties.

Warranty may be voided if leak detecting additives have been used.

### Vacuum pull-down moisture removal

Moisture obstructs the proper functioning of the compressor and the refrigeration system.

Air and moisture reduce service life and increase condensing pressure, and cause

excessively high discharge temperatures, which can destroy the lubricating properties of the oil. Air and moisture also increase the risk of acid formation, giving rise to copper plating. All these phenomena can cause mechanical and electrical compressor failure.

## Application guidelines

## Installation and service

To eliminate these factors, a vacuum pull-down according to the following procedure is recommended:

- ① Whenever possible (if valves are present) the compressor must be kept isolated from the system.
  - ② After the leak detection, the system must be pulled-down under a vacuum of 500 microns. A two stage vacuum pump shall be used with a capacity appropriate to the system volume. It is recommended to use connection lines with a large diameter and to connect these to the service valves and not to the schrader connection to avoid too high pressure losses.
  - ③ When the vacuum level of 500 micron is reached, the system must be isolated from the vacuum pump. Wait 30 minutes during which the system pressure should not rise. When the pressure rapidly increases, the system is not leak tight.
- A new leak detection must be performed and the vacuum pull-down procedure should be

restarted from step 1. When the pressure slowly increases, this indicates the presence of moisture. In this case step 2 and 3 should be repeated.

- ④ Connect the compressor to the system by opening the valves. Repeat step 2 and 3.

⑤ Break the vacuum with nitrogen or the final refrigerant.

- ⑥ Repeat step 2 and 3 on the total system.

At commissioning, system moisture content may be up to 100 ppm. During operation the filter drier must reduce this to a level < 20 ppm.

**Warning :** Do not use a megohmmeter or apply power to the compressor while it is under vacuum, as this may cause motor winding damage.

Never run the compressor under vacuum as it may cause compressor motor burn-out.

### Start-up

Before initial start-up or after a prolonged shut down period, energise the crankcase heater (if fitted) 12 hours prior to start-up, or

turn on power for single phase compressors with trickle circuit.

### Refrigerant charging

Zeotropic and "near-azeotropic" refrigerant mixtures such as R407C and R404A must always be charged in the liquid phase. For the initial charge, the compressor must not run and service valves must be closed. Charge refrigerant as close as possible to the nominal system charge before starting the compressor. Then slowly add refrigerant in the liquid phase, on the low pressure side as far away as possible from the running compressor.

The refrigerant charge quantity must be suitable for both winter and summer operation. Refer also to section "Protection against flooded starts and liquid floodback" for information about refrigerant charge limits.

**WARNING:** when a liquid line solenoid valve is used, the vacuum in the low pressure side must be broken before applying power to the system.

### Oil charge and oil level

The oil charge must be checked before commissioning (1/4 to 3/4 of the oil sight glass). Check the oil level again after a minimum of 2 hours operation at nominal conditions. In most installations the initial compressor oil charge will be sufficient. In installations with line runs exceeding 66 ft or with many oil traps or an oil separator, additional oil may be required. Normally the quantity of oil added should be no more than 2% of the total refrigerant charge (this percentage does not take into account oil contained in acces-

sories such as oil separators or oil traps). If this amount has already been added and the oil level in the compressor keeps decreasing, the oil return in the installation is insufficient. Refer also to section "Piping design".

In installations where slow oil return is likely such as in multiple evaporator or multiple condenser installations, an oil separator is recommended. Refer to the table on page 17 to select the correct oil.

## Application guidelines

### Suction gas superheat

## Ordering information and packaging

The optimum suction gas superheat is 14.5°F. A lower superheat value will contribute to better system performance (higher mass flow and more efficient use of evaporator surface). Low superheat values however increase the risk of unwanted liquid floodback to the compressor.

For very low superheat values an electronically controlled expansion valve is recommended.

The maximum allowable superheat is about 54°F. Higher values can be accepted but in these cases, tests have to be performed to check that the maximum discharge temperature of 266°F will not be exceeded. Note that high superheat values decrease the compressor application envelope and system performance.

## Packaging



Model		Single pack		Multipack				Industrial pack			
		Dimensions (in)	Gross weight (lbs)	Nbr	Dimensions (in)	Gross weight (lbs)	Static stacking	Nbr	Dimensions (in)	Gross weight (lbs)	Static stacking
1 cylinder	MT/MTZ 018	I: 13.0 w: 11.6 h: 15.2	50.7	8	I: 45.3 w: 31.5 h: 20.1	435	4	12	I: 45.3 w: 31.5 h: 19.7	613	4
	MT/MTZ 022		50.7			435				613	
	MT/MTZ 028		55.1			470				666	
	MT/MTZ 032		57.3			487				693	
	MT/MTZ 036		59.5			505				719	
	MT/MTZ 040		59.5			505				719	
2 cylinders	MT/MTZ 044-050	I: 15.6 w: 14.4 h: 17.9	81.6	6	I: 45.3 w: 31.5 h: 23.6	512	4	6	I: 45.3 w: 31.5 h: 23.6	494	4
	MT/MTZ 045-051		86.0			538				520	
	MT/MTZ 056-064		86.0			538				520	
	MT/MTZ 057-065		90.4			565				547	
	MT/MTZ 072-080		92.6			578				560	
	MT/MTZ 073-081		94.8			591				573	
4 cylinders	MT/MTZ 100	I: 22.4 w: 15.7 h: 26.4	154.4	4	I: 45.3 w: 31.5 h: 32.3	642	4	6	I: 45.3 w: 31.5 h: 28.0	840	4
	MT/MTZ 125		161.0			668				880	
	MT/MTZ 144		167.6			695				920	
	MT/MTZ 160		172.0			712				946	

Single pack: One compressor in a cardboard box.  
In some publications this packaging may be indicated as "individual packaging".

Multipack: A full pallet of compressors, each individually packed in a cardboard box. Mainly dedicated to wholesalers and Danfoss distribution centers.

Industrial pack: A full pallet of unpacked compressors. Mainly dedicated to OEM customers.  
In some publications this packaging may be indicated as "Multiple packaging".

Nbr: Number of compressor in a pack

**MT compressors in industrial pack**
**R22**

Compressor model	Design <sup>1)</sup>	Code no.				
		1	3	4	5	9
		208-230/1/60	200-230/3/60	460/3/60 400/3/50	230/1/50	380/3/60
<b>MT018</b>	S	-	MT18-3M	MT18-4M	MT18-5M	-
	VE	MT18-1VM	MT18-3VM	MT18-4VM	MT18-5VM	-
<b>MT022</b>	S	MT22-1M	MT22-3M	MT22-4M	MT22-5M	-
	VE	MT22-1VM	MT22-3VM	MT22-4VM	MT22-5VM	MT22-9VM
<b>MT028</b>	S	MT28-1M	MT28-3M	MT28-4M	MT28-5M	-
	VE	MT28-1VM	MT28-3VM	MT28-4VM	MT28-5VM	MT28-9VM
<b>MT032</b>	S	-	MT32-3M	MT32-4M	MT32-5M	-
	VE	MT32-1VM	MT32-3VM	MT32-4VM	MT32-5VM	MT32-9VM
<b>MT036</b>	S	-	MT36-3M	MT36-4M	MT36-5M	-
	VE	MT36-1VM	MT36-3VM	MT36-4VM	MT36-5VM	MT36-9VM
<b>MT040</b>	S	MT40-1M	MT40-3M	MT40-4M	-	-
	VE	MT40-1VM	MT40-3VM	MT40-4VM	-	-
<b>MT044</b>	S	MT44-1M	MT44-3M	MT44-4M	-	MT44-9M
	VE	MT44-1VM	MT44-3VM	MT44-4VM	-	MT44-9VM
<b>MT045</b>	S	-	-	MT45-4M	-	-
	VE	-	MT45-3VM	MT45-4VM	-	-
<b>MT050</b>	S	-	MT50-3M	MT50-4M	-	MT50-9M
	VE	MT50-1VM	MT50-3VM	MT50-4VM	MT50-5VM	MT50-9VM
<b>MT051</b>	S	-	MT51-3M	MT51-4M	-	-
	VE	-	MT51-3VM	MT51-4VM	-	-
<b>MT056</b>	S	-	MT56-3M	MT56-4M	-	MT56-9M
	VE	MT56-1VM	MT56-3VM	MT56-4VM	-	MT56-9VM
<b>MT057</b>	S	-	-	MT57-4M	-	-
	VE	-	MT57-3VM	MT57-4VM	-	-
<b>MT064</b>	S	-	MT64-3M	MT64-4M	-	MT64-9M
	VE	MT64-1VM	MT64-3VM	MT64-4VM	-	MT64-9VM
<b>MT065</b>	S	-	MT65-3M	MT65-4M	-	-
	VE	-	MT65-3VM	MT65-4VM	-	-
<b>MT072</b>	S	-	MT72-3M	MT72-4M	-	MT72-9M
	VE	-	MT72-3VM	MT72-4VM	-	MT72-9VM
<b>MT073</b>	S	-	MT73-3M	MT73-4M	-	-
	VE	-	MT73-3VM	MT73-4VM	-	-
<b>MT080</b>	S	-	-	MT80-4M	-	MT80-9M
	VE	-	MT80-3VM	MT80-4VM	-	MT80-9VM
<b>MT081</b>	S	-	-	MT81-4M	-	-
	VE	-	MT81-3VM	MT81-4VM	-	-
<b>MT100</b>	Sv	-	MT100-3M	MT100-4M	-	MT100-9M
	VE	-	MT100-3VM	MT100-4VM	-	MT100-9VM
<b>MT125</b>	Sv	-	MT125-3M	MT125-4M	-	MT125-9VM
	VE	-	MT125-3VM	MT125-4VM	-	MT125-9VM
<b>MT144</b>	Sv	-	MT144-3M	MT144-4M	-	MT144-9M
	VE	-	MT144-3VM	MT144-4VM	-	MT144-9VM
<b>MT160</b>	Sv	-	MT160-3M	MT160-4M	-	MT160-9M
	VE	-	MT160-3VM	MT160-4VM	-	MT160-9VM

<sup>1)</sup> S = Single compressor, no oil sight glass, no oil equalization connection  
SV = Single compressor, welded oil sight glass, no oil equalization connection  
VE = Single compressor, threaded oil sight glass, 3/8" oil equalization connection

**MT compressors in single pack**
**R22**

Compressor model	Design <sup>1)</sup>	Code no.						
		1	3	4	5	6	7	9
		208-230/1/60	200-230/3/60	460/3/60 400/3/50	230/1/50	230/3/50	575/3/60 500/3/50	380/3/60
<b>MT018</b>	VE	MT18-1VI	MT18-3VI	MT18-4VI	MT18-5VI	-	-	-
<b>MT022</b>	VE	MT22-1VI	MT22-3VI	MT22-4VI	MT22-5VI	MT22-6VI	-	MT22-9VI
<b>MT028</b>	VE	MT28-1VI	MT28-3VI	MT28-4VI	MT28-5VI	MT28-6VI	-	MT28-9VI
<b>MT032</b>	VE	MT32-1VI	MT32-3VI	MT32-4VI	MT32-5VI	MT32-6VI	-	MT32-9VI
<b>MT036</b>	VE	MT36-1VI	MT36-3VI	MT36-4VI	MT36-5VI	MT36-6VI	-	MT36-9VI
<b>MT040</b>	VE	MT40-1VI	MT40-3VI	MT40-4VI	-	MT40-6VI	-	-
<b>MT044</b>	VE	MT44-1VI	MT44-3VI	MT44-4VI	-	MT44-6VI	MT44-7VI	MT44-9VI
<b>MT045</b>	VE	-	MT45-3VI	MT45-4VI	-	-	-	-
<b>MT050</b>	VE	MT50-1VI	MT50-3VI	MT50-4VI	MT50-5VI	MT50-6VI	MT50-7VI	MT50-9VI
<b>MT051</b>	VE	-	MT51-3VI	MT51-4VI	-	-	-	-
<b>MT056</b>	VE	MT56-1VI	MT56-3VI	MT56-4VI	-	MT56-6VI	MT56-7VI	MT56-9VI
<b>MT057</b>	VE	-	MT57-3VI	MT57-4VI	-	-	-	-
<b>MT064</b>	VE	MT64-1VI	MT64-3VI	MT64-4VI	-	MT64-6VI	-	MT64-9VI
<b>MT065</b>	VE	-	MT65-3VI	MT65-4VI	-	-	-	-
<b>MT072</b>	VE	-	MT72-3VI	MT72-4VI	-	MT72-6VI	-	MT72-9VI
<b>MT073</b>	VE	-	MT73-3VI	MT73-4VI	-	-	-	-
<b>MT080</b>	VE	-	MT80-3VI	MT80-4VI	-	MT80-6VI	-	MT80-9VI
<b>MT081</b>	VE	-	MT81-3VI	MT81-4VI	-	-	-	-
<b>MT100</b>	VE	-	MT100-3VI	MT100-4VI	-	MT100-6VI	MT100-7VI	MT100-9VI
<b>MT125</b>	VE	-	MT125-3VI	MT125-4VI	-	MT125-6VI	MT125-7VI	MT125-9VI
<b>MT144</b>	VE	-	MT144-3VI	MT144-4VI	-	MT144-6VI	MT144-7VI	MT144-9VI
<b>MT160</b>	VE	-	MT160-3VI	MT160-4VI	-	MT160-6VI	MT160-7VI	MT160-9VI

<sup>1)</sup> VE = Single compressor, threaded oil sight glass, 3/8" oil equalization connection

## MTZ compressors in industrial pack

## R404A / R507A / R134a / R407C

Compressor model	Design <sup>1)</sup>	Code no.				
		1	3	4	5	9
		208-230/1/60	200-230/3/60	460/3/60 400/3/50	230/1/50	380/3/60
MTZ018	S	MTZ18-1M	MTZ18-3M	MTZ18-4M	MTZ18-5M	-
	VE	MTZ18-1VM	MTZ18-3VM	MTZ18-4VM	MTZ18-5VM	-
MTZ022	S	MTZ22-1M	MTZ22-3M	MTZ22-4M	MTZ22-5M	-
	VE	MTZ22-1VM	MTZ22-3VM	MTZ22-4VM	MTZ22-5VM	MTZ22-9VM
MTZ028	S	MTZ28-1M	MTZ28-3M	MTZ28-4M	MTZ28-5M	-
	VE	MTZ28-1VM	MTZ28-3VM	MTZ28-4VM	MTZ28-5VM	MTZ28-9VM
MTZ032	S	MTZ32-1M	MTZ32-3M	MTZ32-4M	MTZ32-5M	-
	VE	MTZ32-1VM	MTZ32-3VM	MTZ32-4VM	MTZ32-5VM	MTZ32-9VM
MTZ036	S	MTZ36-1M	MTZ36-3M	MTZ36-4M	MTZ36-5M	-
	VE	MTZ36-1VM	MTZ36-3VM	MTZ36-4VM	MTZ36-5VM	MTZ36-9VM
MTZ040	S	MTZ40-1M	MTZ40-3M	MTZ40-4M	-	-
	VE	MTZ40-1VM	MTZ40-3VM	MTZ40-4VM	-	-
MTZ044	S	-	MTZ44-3M	MTZ44-4M	-	MTZ44-9M
	VE	MTZ44-1VM	MTZ44-3VM	MTZ44-4VM	-	MTZ44-9VM
MTZ045	S	-	-	MTZ45-4M	-	-
	VE	-	MTZ45-3VM	MTZ45-4VM	-	-
MTZ050	S	-	MTZ50-3M	MTZ50-4M	-	MTZ50-9M
	VE	MTZ50-1VM	MTZ50-3VM	MTZ50-4VM	MTZ50-5VM	MTZ50-9VM
MTZ051	S	-	-	MTZ51-4M	-	-
	VE	-	MTZ51-3VM	MTZ51-4VM	-	-
MTZ056	S	-	MTZ56-3M	MTZ56-4M	-	MTZ56-9M
	VE	MTZ56-1VM	MTZ56-3VM	MTZ56-4VM	-	MTZ56-9VM
MTZ057	S	-	-	MTZ57-4M	-	-
	VE	-	MTZ57-3VM	MTZ57-4VM	-	-
MTZ064	S	-	MTZ64-3M	MTZ64-4M	-	MTZ64-9M
	VE	MTZ64-1VM	MTZ64-3VM	MTZ64-4VM	-	MTZ64-9VM
MTZ065	S	-	-	MTZ65-4M	-	-
	VE	-	MTZ65-3VM	MTZ65-4VM	-	-
MTZ072	S	-	MTZ72-3M	MTZ72-4M	-	MTZ72-9M
	VE	-	MTZ72-3VM	MTZ72-4VM	-	MTZ72-9VM
MTZ073	S	-	-	MTZ73-4M	-	-
	VE	-	MTZ73-3VM	MTZ73-4VM	-	-
MTZ080	S	-	-	MTZ80-4M	-	MTZ80-9M
	VE	-	MTZ80-3VM	MTZ80-4VM	-	MTZ80-9VM
MTZ081	S	-	-	MTZ81-4M	-	-
	VE	-	MTZ81-3VM	MTZ81-4VM	-	-
MTZ100	Sv	-	MTZ100-3M	MTZ100-4M	-	MTZ100-9M
	VE	-	MTZ100-3VM	MTZ100-4VM	-	MTZ100-9VM
MTZ125	Sv	-	MTZ125-3M	MTZ125-4M	-	MTZ125-9M
	VE	-	MTZ125-3VM	MTZ125-4VM	-	MTZ125-9VM
MTZ144	Sv	-	MTZ144-3M	MTZ144-4M	-	MTZ144-9M
	VE	-	MTZ144-3VM	MTZ144-4VM	-	MTZ144-9VM
MTZ160	Sv	-	MTZ160-3M	MTZ160-4M	-	MTZ160-9M
	VE	-	MTZ160-3VM	MTZ160-4VM	-	MTZ160-9VM

1) S = Single compressor, no oil sight glass, no oil equalization connection

Sv = Single compressor, welded oil sight glass, no oil equalization connection

VE = Single compressor, threaded oil sight glass, 3/8" oil equalization connection

**MTZ compressors in single pack**
**R404A / R507A / R134a / R407C**

Compressor model	Design <sup>1)</sup>	Code no.						
		1	3	4	5	6	7	9
		208-230/1/60	200-230/3/60	460/3/60 400/3/50	230/1/50	230/3/50	575/3/60 500/3/50	380/3/60
<b>MTZ018</b>	VE	MTZ18-1VI	MTZ18-3VI	MTZ18-4VI	MTZ18-5VI	-	-	-
<b>MTZ022</b>	VE	MTZ22-1VI	MTZ22-3VI	MTZ22-4VI	MTZ22-5VI	MTZ22-6VI	-	MTZ22-9VI
<b>MTZ028</b>	VE	MTZ28-1VI	MTZ28-3VI	MTZ28-4VI	MTZ28-5VI	MTZ28-6VI	-	MTZ28-9VI
<b>MTZ032</b>	VE	MTZ32-1VI	MTZ32-3VI	MTZ32-4VI	MTZ32-5VI	MTZ32-6VI	MTZ32-7VI	MTZ32-9VI
<b>MTZ036</b>	VE	MTZ36-1VI	MTZ36-3VI	MTZ36-4VI	MTZ36-5VI	MTZ36-6VI	MTZ36-7VI	MTZ36-9VI
<b>MTZ040</b>	VE	MTZ40-1VI	MTZ40-3VI	MTZ40-4VI	-	MTZ40-6VI	-	-
<b>MTZ044</b>	VE	MTZ44-1VI	MTZ44-3VI	MTZ44-4VI	-	MTZ44-6VI	MTZ44-7VI	MTZ44-9VI
<b>MTZ045</b>	VE	-	MTZ45-3VI	MTZ45-4VI	-	-	-	-
<b>MTZ050</b>	VE	MTZ50-1VI	MTZ50-3VI	MTZ50-4VI	MTZ50-5VI	MTZ50-6VI	MTZ50-7VI	MTZ50-9VI
<b>MTZ051</b>	VE	-	MTZ51-3VI	MTZ51-4VI	-	-	-	-
<b>MTZ056</b>	VE	MTZ56-1VI	MTZ56-3VI	MTZ56-4VI	-	MTZ56-6VI	MTZ56-7VI	MTZ56-9VI
<b>MTZ057</b>	VE	-	MTZ57-3VI	MTZ57-4VI	-	-	-	-
<b>MTZ064</b>	VE	MTZ64-1VI	MTZ64-3VI	MTZ64-4VI	-	MTZ64-6VI	-	MTZ64-9VI
<b>MTZ065</b>	VE	-	MTZ65-3VI	MTZ65-4VI	-	-	-	-
<b>MTZ072</b>	VE	-	MTZ72-3VI	MTZ72-4VI	-	MTZ72-6VI	-	MTZ72-9VI
<b>MTZ073</b>	VE	-	MTZ73-3VI	MTZ73-4VI	-	-	-	-
<b>MTZ080</b>	VE	-	MTZ80-3VI	MTZ80-4VI	-	MTZ80-6VI	-	MTZ80-9VI
<b>MTZ081</b>	VE	-	MTZ81-3VI	MTZ81-4VI	-	-	-	-
<b>MTZ100</b>	VE	-	MTZ100-3VI	MTZ100-4VI	-	MTZ100-6VI	MTZ100-7VI	MTZ100-9VI
<b>MTZ125</b>	VE	-	MTZ125-3VI	MTZ125-4VI	-	MTZ125-6VI	MTZ125-7VI	MTZ125-9VI
<b>MTZ144</b>	VE	-	MTZ144-3VI	MTZ144-4VI	-	MTZ144-6VI	MTZ144-7VI	MTZ144-9VI
<b>MTZ160</b>	VE	-	MTZ160-3VI	MTZ160-4VI	-	MTZ160-6VI	MTZ160-7VI	MTZ160-9VI

<sup>1)</sup> VE = Single compressor, threaded oil sight glass, 3/8" oil equalization connection



## The Danfoss product range for the refrigeration and air conditioning industry

Danfoss Refrigeration & Air Conditioning is a worldwide manufacturer with a leading position in industrial, commercial and supermarket refrigeration as well as air conditioning and climate solutions.

We focus on our core business of making quality products, components and systems that enhance performance and reduce total life cycle costs – the key to major savings.



*Controls for Commercial Refrigeration*



*Controls for Industrial Refrigeration*



*Electronic Controls & Sensors*



*Industrial Automation*



*Household Compressors*



*Commercial Compressors*



*Sub-Assemblies*



*Thermostats*



*Brazed plate heat exchanger*

We are offering a single source for one of the widest ranges of innovative refrigeration and air conditioning components and systems in the world. And, we back technical solutions with business solution to help your company reduce costs, streamline processes and achieve your business goals.

**[www.danfoss.us](http://www.danfoss.us)**